

SUBMITTAL SET
AFFINITY CONSOLE
COMMERCIAL GEOTHERMAL/
WATER SOURCE HEAT PUMPS
SINGLE CAPACITY

MODELS: YC09 - 18 (.75 THRU 1.5 NOMINAL TONS)







Due to continuous product improvement, specifications are subject to change without notice.


Visit us on the web at www.yorkgeothermal.com

Additional rating information can found at **www.ahridirectory.org**

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tog:	



Model Nomenclature

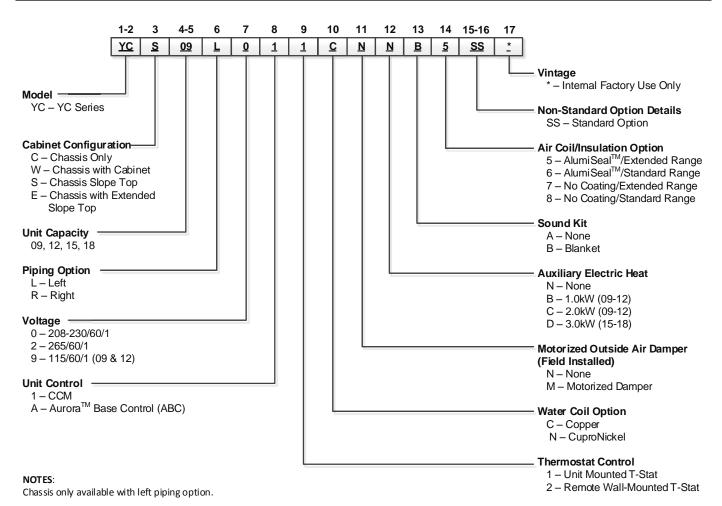

Voltage Availability

Voltage		Мо	odel	
voitage	09	12	15	18
115/60/1	•	•		
208-230/60/1	•	•	•	•
265/60/1	•	•	•	•

1/20/14





All Affinity Console Series product is Safety listed under UL1995 thru ETL and performance listed with AHRI in accordance with standard 13256-1.

Contractor:	P.O.:	
Engineer:		
Proiect Name:	Unit Tag:	



AHRI Data

ECM Motors

AHRI/ASHRAE/ISO 13256-1

English (IP) Units

			\	Nater Loop	Heat Pump)	G	round Wate	er Heat Pum	ıp	Ground Loop Heat Pump			
Model	Flow	Rate	Coo EWT	ling 86°F	Hea EWT	•	Coo EWT	-	Hea EWT	•	Coo EWT	-	Heat EWT	-
	gpm	cfm	Capacity Btuh	EER Btuh/W	Capacity Btuh	СОР	Capacity Btuh	EER Btuh/W	Capacity Btuh	СОР	Capacity Btuh	EER Btuh/W	Capacity Btuh	СОР
09	2.5	300	8,500	13.4	10,500	4.4	10,200	22.5	8,700	3.8	9,000	16.0	6,700	3.1
12	3.5	350	10,500	12.3	14,400	4.3	12,400	19.5	11,800	3.7	11,000	14.2	9,500	3.5
15	4.5	450	13,500	13.6	17,000	4.9	16,200	22.0	14,000	4.1	14,200	15.9	10,500	3.4
18	5.5	500	16,200	12.5	21,000	4.4	19,000	19.6	17,000	3.7	16,600	15.1	13,300	3.1

Cooling capacities based upon 80.6°F DB, 66.2°F WB entering air temperature Heating capacities based upon 68°F DB, 59°F WB entering air temperature All ratings based upon operation at the lower voltage of dual voltage rated models.


12/14/09

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Dimensional Data - Flat Top Cabinet

YCW09-18

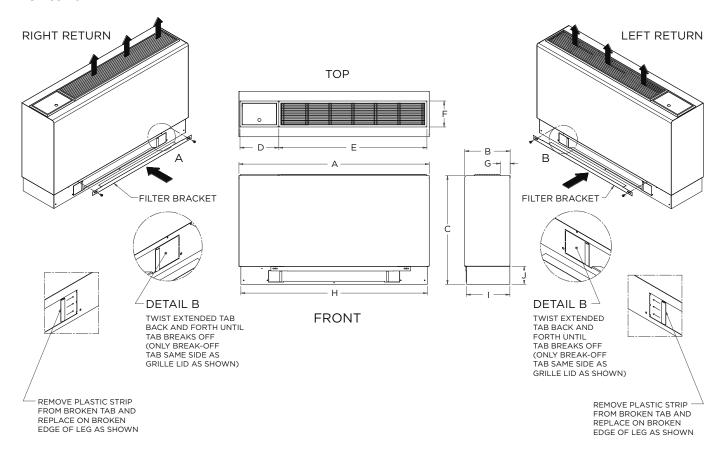


		Ove	erall Ca	abinet							
Flat	-	Α	В	С	D	E	F	G	Н	I	J
Configu	ıration	Width	Depth	Height	Grille Lid	Grille Length	Grille Width				
09-12	in.	45.0	10.8	25.7	9.2	35.0	6.1	2.3	44.1	10.3	4.3
07-12	cm.	114.3	27.3	65.2	23.4	88.9	15.6	5.8	112.0	26.0	10.9
15-18	in.	50.0	12.3	25.7	9.2	35.0	6.1	3.3	49.1	11.8	4.3
13-10	cm.	127.0	31.1	65.2	23.4	88.9	15.6	8.3	124.7	29.8	10.9

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Dimensional Data - Slope Top Cabinet

YCS09-18

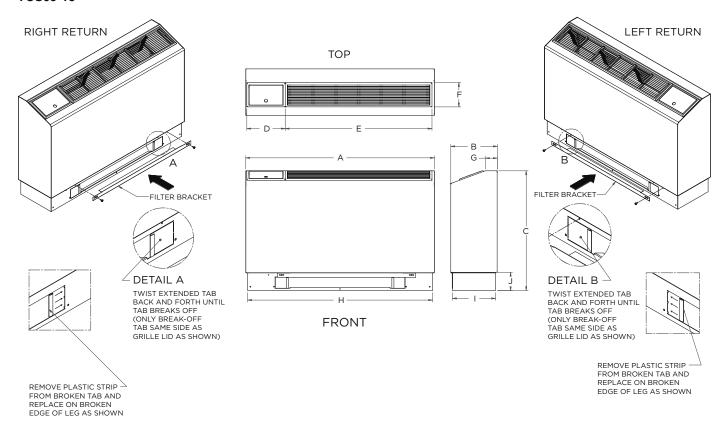


Slope Top		Overall Cabinet									
•	-	Α	В	С	D	E	F	G	Н	I	J
Configuration		Width	Depth	Height	Grille Lid	Grille Length	Grille Width				
09-12	in.	45.0	11.1	28.6	9.2	35.0	6.1	2.8	44.1	10.3	4.3
07-12	cm.	114.3	28.2	72.6	23.4	88.9	15.6	7.2	112.0	26.0	10.9
15-18	in.	50.0	12.6	29.1	9.2	35.0	6.1	2.5	49.1	11.8	4.3
10-10	cm.	127.0	32.0	73.9	23.4	88.9	15.6	6.4	124.7	29.8	10.9

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Dimensional Data - Extended Slope Top Cabinet

YCE09-18

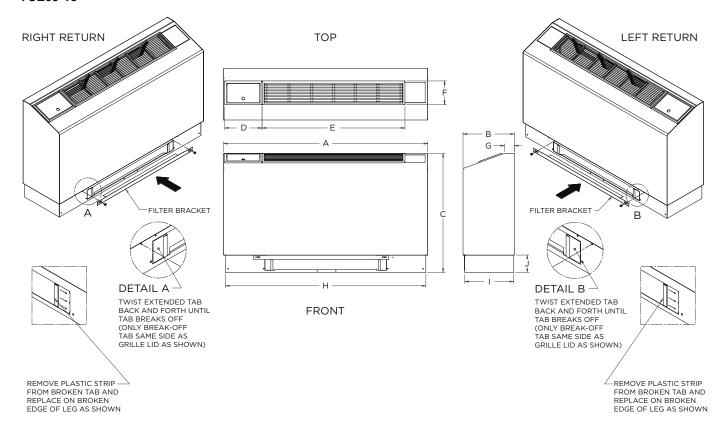



Ext. Slope Top			erall Ca	abinet							
	-	Λ	В	С	D	Е	F	G	Н	1	J
Configu	iration	Width	Depth	Height	Grille Lid	Grille Length	Grille Width				
09-12	in.	50.0	12.6	29.1	9.2	35.0	6.1	2.4	49.1	12.0	4.3
07-12	cm.	127.0	32.0	73.9	23.4	88.9	15.6	6.1	124.7	30.5	10.9
15-18	in.	55.0	12.6	29.1	9.2	35.0	6.1	2.5	54.1	11.8	4.3
13-10	cm.	139.7	32.0	73.9	23.4	88.9	15.6	6.4	137.4	29.8	10.9

Contractor:	P.O.:
Engineer:	
Duningt Name	Linit Ton.



Dimensional Data - Right Return Controls Detail

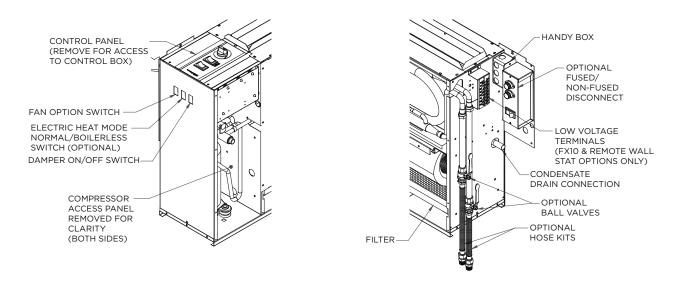

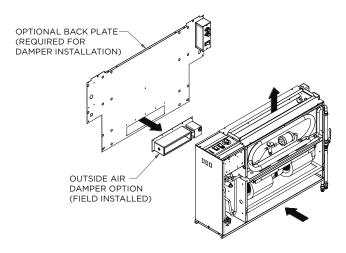


The manufacturer works continually to improve its products. As a result, the design and specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.


Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	




Dimensional Data - Right Return Chassis

Data = inches (cm)



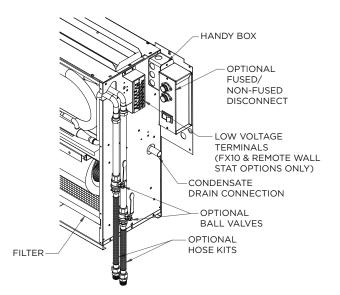


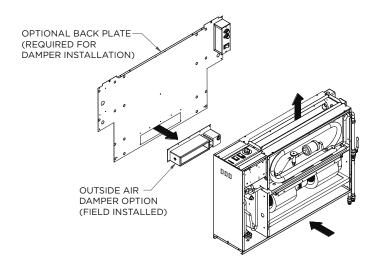


Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Dimensional Data - Left Return Controls Detail

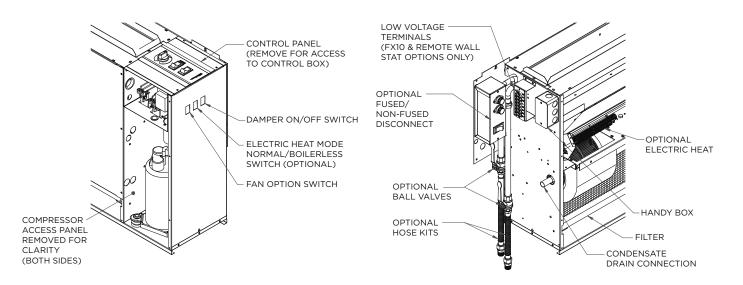

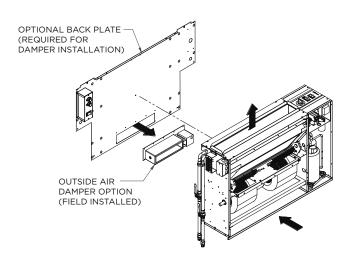



Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	




Dimensional Data - Left Return Chassis


Data = inches (cm)







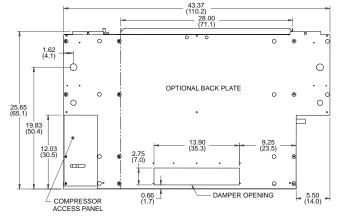

Models 15-18





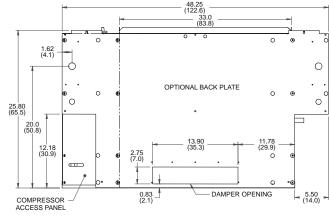

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Physical Data

	Consoles								
Model	09		12		15		18	3	
Compressor (1 each)					Rot	ary		-	
Factory Charge R410A, oz [kg]		27 [0.77]		27 [0.7	77]	36 [1	.02]	34 [0	.96]
Fan Motor & Blower									
Fan Motor Type/Speeds	ECM				3 Sp	eeds			
Fan Motor- hp [W]	ECM	0.25 [186]		0.25 [1	86]	0.25 [186]	0.25 [186]
Blower Wheel Size (Dia x W), in. [mm]	ower Wheel Size (Dia x W), in, [mm]		Î	5.75 x		6.0 x		6.0 x	
, , , , ,		[146 x 140]		[146 x 1	40]	[152 x	165]	[152 x	165]
Coax and Water Piping									
Water Connections Size - FPT - in [mn	n]	1/2" [12.7]	1/2" [12.7]		2.7]	1/2" [12.7]		1/2" [12.7]
Coax & Piping Water Volume - gal [I]		0.15 [0.6]		0.18 [0).7]	0.35 [1.3]	0.35	[1.3]
Consoles									
Air Coil Dimensions (H x W), in. [mm]	1	8 x 22 [20	3	8 x 22		8 x 30	[203	8 x 30	[203
7 til Coll Billionolono (11 x vv); ill. [illini	J	x 559]		x 559)]	x 76	2]	x 76	52]
Air Coil Total Face Area, ft2 [m2]		1.2 [0.114]		1.2 [0.1	14]	1.7 [0.	155]	1.7 [0.	.155]
Air Coil Tube Size, in [mm]		3/8 [9.5]		3/8 [9	.5]	3/8 [9	9.5]	3/8 [9.5]
Air Coil Number of rows	Air Coil Number of rows			3		4		4	
Filter Standard - 1" [25.44mm]	Filter Standard - 1" [25 44mm]			1 - 10 x	28	1 - 12 x 33		1 - 12	x 33
		[254 x 711]	4	[254 x 7		[305 x		[305 x	
Weight - Operating, lb [kg]		210 [91]		210 [9	5]	230 [1	02]	235 [107]
Weight - Packaged, lb [kg]		220 [100]		220 [10	00]	240 [1	09]	245 [111]

1/20/14

Contractor:	P.O.:	_
Engineer:		
Project Name:	Unit Tag	



Electrical Data

ECM Motor

	Rated	Voltage	(Compresso	r	Fan	Total	Min	Max
Model	Voltage	Min/Max	мсс	RLA	LRA	Motor FLA	Unit FLA	Circ Amp	Fuse/ HACR
	115/60/1	104/127	12.5	8.0	50.0	4.25	12.3	14.3	20
09	208-230/60/1	187/253	6.4	4.1	21.0	2.6	6.7	7.7	10/15
	265/60/1	238/292	6.7	4.3	22.0	2.5	6.8	7.9	10/15
	115/60/1	104/127	14.8	9.5	50.0	4.25	13.8	16.1	25
12	208-230/60/1	187/253	7.7	4.9	25.0	2.6	7.5	8.8	10/15
	265/60/1	238/292	7.0	4.5	22.0	2.5	7.0	8.1	10/15
15	208-230/60/1	187/253	9.2	5.9	29.0	2.6	8.5	10.0	15
15	265/60/1	238/292	7.8	5.0	28.0	2.5	7.5	8.8	10/15
18	208-230/60/1	187/253	10.4	6.7	33.5	2.6	9.3	10.9	15
18	265/60/1	238/292	8.7	5.6	28.0	2.5	8.1	9.5	15

HACR circuit breaker in USA only

1/20/14

Contractor:	P.O.:	
Engineer:		
Proiect Name:	Unit Tag:	



Auxiliary Heat Ratings

ECM Motors

Model	Rated Voltage	Voltage Min./Max.	Heater Element Watts	Fan Motor FLA	Heater Element FLA	Total Unit FLA	Min. Circuit Amp.	Max. Fuse/ Brkr.
	208/60/1	197/254	818	2.45	3.93	6.4	8.0	10
09-12 (1 kW)	230/60/1	197/254	1000	2.60	4.35	7.0	8.7	15
(T KVV)	265/60/1	239/291	1000	2.50	3.77	6.3	7.8	10
	208/60/1	197/254	1636	2.45	7.86	10.3	12.9	20
09-12 (2 kW)	230/60/1	197/254	2000	2.60	8.70	11.3	14.1	25
(Z KVV)	265/60/1	239/292	2000	2.50	7.55	10.1	12.6	20
	208/60/1	197/254	2454	2.45	11.80	14.3	17.8	30
15-18 (3 kW)	230/60/1	197/254	3000	2.60	13.04	15.6	19.6	35
(3 KVV)	265/60/1	239/292	3000	2.50	11.32	13.8	17.3	30

Always refer to unit nameplate data prior to installation.

10/5/10

Blower Performance Data

ECM Motors

Model	CFM								
Wodei	Low Speed	Medium Speed	High Speed						
09	300	325	400						
12	300	325	400						
15	350	450	600						
18	350	450	600						

For wet coil performance first calculate the face velocity of the air coil (Face Velocity [fpm] = Airflow [cfm] / Face Area [sq ft]). Then for velocities of 200 fpm reduce the static capability by 0.03 in. wg, 300 fpm by 0.08 in. wg, 400 fpm by 0.12in. wg. and 500 fpm by 0.16 in. wg.

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Pressure Drop

Model	GPM	Pressure Drop (psi)								
wodei	GPIVI	30°F	50°F	70°F	90°F	110°F				
	1.2	1.0	0.9	0.8	0.7	0.6				
09	1.8	2.3	2.2	2.0	1.9	1.8				
	2.5	3.8	3.7	3.5	3.3	3.1				
	1.5	0.9	0.8	0.7	0.6	0.5				
12	2.3	1.7	1.5	1.4	1.3	1.1				
	3.5	3.0	2.7	2.5	2.4	2.2				
	2.0	1.7	1.6	1.5	1.4	1.3				
15	3.0	3.3	3.2	3.0	2.9	2.8				
	4.5	5.7	5.5	5.3	5.1	4.9				
	3.0	1.7	1.6	1.5	1.4	1.3				
18	4.0	4.1	4.0	3.9	3.7	3.6				
	5.5	7.9	7.6	7.4	7.2	6.9				

12/14/09

Correction Factor Tables

Cooling Capacity Corrections

Entering	Total			Sensible	Cooling	Capacity	Multiplier	s - Enterir	ng DB ℉			Power	Heat of
Air WB °F	Clg Cap	60	65	70	75	80	80.6	85	90	95	100	Input	put Rejection
45	0.719	0.891	1.058	1.128	*	*	*	*	*	*	*	0.898	0.741
50	0.719	0.893	0.980	1.106	*	*	*	*	*	*	*	0.898	0.741
55	0.812	0.629	0.844	1.026	1.172	*	*	*	*	*	*	0.922	0.819
60	0.897			0.820	0.995	1.206	1.238	*	*	*	*	0.955	0.895
65	0.960			0.568	0.810	1.004	1.052	1.227	*	*	*	0.982	0.951
66.2	0.984			0.505	0.743	1.002	1.027	1.151	*	*	*	0.993	0.980
67	1.000			0.463	0.699	1.000	1.011	1.101	1.310	*	*	1.000	1.000
70	1.047				0.599	0.865	0.879	1.007	1.225	1.433	*	1.018	1.029
75	1.148					0.567	0.584	0.734	0.956	1.261	1.476	1.056	1.118

Note: * Sensible capacity equals total capacity at conditions shown.

7/20/06

Heating Capacity Corrections

	Heating Corrections											
Ent Air DB °F	Htg Cap	Power	Heat of Ext									
45	1.050	0.749	1.158									
50	1.059	0.859	1.130									
55	1.043	0.894	1.096									
60	1.033	0.947	1.064									
65	1.023	0.974	1.030									
68	1.009	0.990	1.012									
70	1.000	1.000	1.000									
75	1.011	1.123	0.970									
80	1.000	1.196	0.930									

7/20/06

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tog:	



Reference Calculations

Heating Calculations:	Cooling Calculations:
LWT = EWT - $\frac{HE}{GPM \times 500}$	$LWT = EWT + \frac{HR}{GPM \times 500}$
$LAT = EAT + \frac{HC}{CFM \times 1.08}$	LAT (DB) = EAT (DB) - SC CFM x 1.08
	LC = TC - SC
TH = HC + HW	$S/T = \underbrace{SC}_{TC}$

Legend

ABBREVIATIONS AND DEFINITIONS:

CFM = airflow, cubic feet/minute ΗE = total heat of extraction, MBTUH EWT = entering water temperature, Fahrenheit HW = desuperheater capacity, MBTUH EER = Energy Efficient Ratio GPM = water flow in gallons/minute WPD = water pressure drop, PSI and feet of water = BTU output/Watt input COP = Coefficient of Performance EAT = entering air temperature, Fahrenheit = BTU output/BTU input (dry bulb/wet bulb) HC = air heating capacity, MBTUH LWT = leaving water temperature, °F TC = total cooling capacity, MBTUH LAT = leaving air temperature, °F SC = sensible cooling capacity, MBTUH TH = total heating capacity, MBTUH ΚW = total power unit input, kilowatts LC = latent cooling capacity, MBTUH S/T HR = total heat of rejection, MBTUH = sensible to total cooling ratio

Operating Limits

Operating Limits	Coo	ling	Heating			
Operating Limits	(°F)	(°C)	(°F)	(°C)		
Air Limits						
Min. Ambient Air	45	7.2	45	7.2		
Rated Ambient Air	80	26.7	70	21.1		
Max. Ambient Air	100	37.8	85	29.4		
Min. Entering Air	50	10.0	40	4.4		
Rated Entering Air db/wb	80.6/66.2	27/19	68	20.0		
Max. Entering Air db/wb	110/83	43/28.3	80	26.7		
Water Limits						
Min. Entering Water	30	-1.1	20	-6.7		
Normal Entering Water	50-110	10-43.3	30-70	-1.1		
Max. Entering Water	120	48.9	90	32.2		

NOTE: Minimum/maximum limits are only for start-up conditions, and are meant for bringing the space up to occupancy temperature. Units are not designed to operate at the minimum/maximum conditions on a regular basis. The operating limits are dependent upon three primary factors: 1) water temperature, 2) return air temperature, and 3) ambient temperature. When any of the factors are at the minimum or maximum levels, the other two factors must be at the normal level for proper and reliable unit operation.

Contractor:	P.O.:	
Engineer:		
Proiect Name:	Unit Tag:	



Antifreeze Corrections

Catalog performance can be corrected for antifreeze use. Please use the following table and note the example given.

Antifreeze Type	Antifreeze % by wt	Cooling Capacity	Heating Capacity	Pressure Drop
EWT - degF [DegC]		90 [32.2]	30 [-1.1]	30 [-1.1]
Water	0	1.000	1.000	1.000
	10	0.991	0.973	1.075
	20	0.979	0.943	1.163
Ethylene Glycol	30	0.965	0.917	1.225
	40	0.955	0.890	1.324
	50	0.943	0.865	1.419
	10	0.981	0.958	1.130
	20	0.969	0.913	1.270
Propylene Glycol	30	0.950	0.854	1.433
	40	0.937	0.813	1.614
	50	0.922	0.770	1.816
	10	0.991	0.927	1.242
	20	0.972	0.887	1.343
Ethanol	30	0.947	0.856	1.383
	40	0.930	0.815	1.523
	50	0.911	0.779	1.639
	10	0.986	0.957	1.127
	20	0.970	0.924	1.197
Methanol	30	0.951	0.895	1.235
	40	0.936	0.863	1.323
	50	0.920	0.833	1.399

Warning: Gray area represents antifreeze concentrations greater than 35% by weight and should be avoided due to the extreme performance penalty they represent.

Antifreeze Correction Example

Antifreeze solution is Propylene Glycol 20% by weight. Determine the corrected heating and cooling performance at 30°F and 90°F respectively as well as pressure drop at 30°F for an Affinity Console Series YC*18.

The corrected cooling capacity at 90°F would be: 17,100 MBtuh x 0.969 = 16,569 MBtuh

The corrected heating capacity at 30°F would be: 14,300 MBtuh x 0.913 = 13,056 MBtuh

The corrected pressure drop at 30°F and 5.5 GPM would be: 18.2 feet of head x 1.270 = 23.1 feet of head

Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:



YC09 - Performance Data

300 Rated CFM Heating / Cooling

Performance capacities shown in thousands of Btuh.

	Flow Rate GPM	Water			HEATIN	G - EAT 7	0 °F		COOLING - EAT 80/67 °F					
°F		Pressur PSI	e Drop FT/HD	HC kBtuh	Power kW	HE kBtuh	LAT °F	СОР	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER
20	1.2 1.8	1.1 2.4	2.5 5.6	C	peration no	ot recomme	ended		Operation not recommended					
	2.5	3.8	8.8	6.8	0.60	4.8	89.0	3.35						
	1.2	1.0	2.3	C	peration no	ot recomme	ended			Operat	ion not rec	ommended		
30	1.8	2.3	5.4	6.9	0.60	4.8	89.3	3.38	12.1	7.3	0.61	0.38	13.4	31.8
	2.5	3.8	8.8	7.3	0.63	5.1	90.5	3.40	12.2	7.4	0.61	0.36	13.4	33.9
	1.2	1.0	2.2	7.6	0.62	5.5	91.5	3.63		Operat	ion not rec	ommended		
40	1.8	2.3	5.2	7.9	0.62	5.8	92.4	3.72	11.5	7.1	0.62	0.41	12.9	28.1
	2.5	3.8	8.7	8.3	0.64	6.1	93.7	3.80	11.6	7.2	0.62	0.39	12.9	30.0
	1.2	0.9	2.1	8.8	0.65	6.6	95.2	4.00	10.7	6.8	0.63	0.45	12.3	23.6
50	1.8	2.2	5.1	9.1	0.65	6.9	96.0	4.08	10.9	6.9	0.63	0.44	12.3	24.9
	2.5	3.7	8.5	9.4	0.66	7.1	97.0	4.17	11.0	7.0	0.64	0.41	12.4	26.6
	1.2	0.9	2.0	10.3	0.68	8.0	99.8	4.46	10.4	6.7	0.64	0.52	12.1	19.9
60	1.8	2.1	4.9	10.5	0.68	8.2	100.5	4.53	10.5	6.7	0.64	0.50	12.2	21.0
	2.5	3.6	8.3	10.8	0.69	8.5	101.3	4.60	10.7	6.9	0.64	0.47	12.3	22.4
	1.2	0.8	1.8	11.8	0.71	9.4	104.5	4.88	10.0	6.5	0.65	0.59	12.0	17.1
70	1.8	2.0	4.7	12.0	0.71	9.6	105.0	4.93	10.1	6.6	0.65	0.56	12.1	18.0
	2.5	3.5	8.1	12.2	0.72	9.8	105.7	4.99	10.3	6.7	0.65	0.54	12.1	19.2
	1.2	0.8	1.7	12.7	0.73	10.2	107.3	5.11	9.5	6.3	0.67	0.65	11.7	14.5
80	1.8	2.0	4.6	12.9	0.74	10.4	107.9	5.12	9.6	6.5	0.67	0.62	11.7	15.5
	2.5	3.4	7.9	13.1	0.75	10.5	108.4	5.13	9.9	6.5	0.66	0.60	11.9	16.4
	1.2	0.7	1.6	13.6	0.76	11.0	110.0	5.24	9.2	6.1	0.67	0.72	11.6	12.7
90	1.8	1.9	4.4	13.8	0.77	11.2	110.6	5.25	9.3	6.2	0.67	0.69	11.7	13.5
	2.5	3.3	7.6	14.0	0.78	11.3	111.2	5.26	9.4	6.3	0.67	0.67	11.7	14.1
	1.2	0.7	1.5			-				Operat	ion not rec	ommended		
100	1.8	1.8	4.3						9.0	6.0	0.67	0.76	11.6	11.8
	2.5	3.2	7.4						9.1	6.1	0.67	0.74	11.6	12.3
	1.2	0.6	1.5							Operat	ion not rec	ommended	-	-
110	1.8	1.8	4.1	C	peration no	ot recomme	ended		8.6	5.8	0.67	0.83	11.5	10.4
	2.5	3.1	7.2						8.7	5.9	0.68	0.81	11.5	10.7
	1.2	0.6	1.4							Operat	ion not rec	ommended	•	
120	1.8	1.7	4.0						8.2	5.5	0.67	0.90	11.3	9.1
	2.5	3.0	6.9						8.3	5.6	0.68	0.88	11.3	9.5

Contractor:	P.O.:
Engineer:	
Drainet Name:	Unit Tog



YC12 - Performance Data

350 Rated CFM Heating / Cooling

Performance capacities shown in thousands of Btuh.

	Flow		iter	HEATING - EAT 70 °F						COOLING - EAT 80/67 °F					
°F	Rate GPM	Pressu	re Drop FT/HD	HC kBtuh	Power kW	HE kBtuh	LAT °F	СОР					HR kBtuh	EER	
	1.5	1.0	2.3												
20	2.3	1.7	4.0		peration no	ot recomme	enaea			Operat	ion not rec	ommended			
	3.5	3.2	7.4	8.6	0.80	5.9	90.8	3.15							
	1.5	0.9	2.1	C	peration no	ot recomme	ended			Operat	ion not rec	ommended			
30	2.3	1.7	3.8	10.0	0.85	7.1	94.3	3.44	14.2	9.8	0.69	0.45	15.8	31.6	
	3.5	3.0	6.9	10.2	0.86	7.3	95.1	3.48	14.4	10.0	0.69	0.42	15.9	34.1	
	1.5	0.9	2.0	10.8	0.88	7.8	96.7	3.62		Operat	ion not rec	ommended			
40	2.3	1.6	3.7	11.0	0.88	8.0	97.0	3.66	13.7	9.5	0.70	0.54	15.5	25.5	
	3.5	2.9	6.6	11.3	0.89	8.2	97.8	3.72	13.9	9.7	0.70	0.50	15.6	27.6	
	1.5	0.8	1.8	11.9	0.91	8.8	99.6	3.86	13.0	9.1	0.70	0.64	15.2	20.2	
50	2.3	1.5	3.5	12.1	0.91	9.0	100.0	3.89	13.1	9.2	0.71	0.62	15.2	21.1	
	3.5	2.7	6.2	12.3	0.92	9.2	100.6	3.94	13.3	9.4	0.71	0.58	15.3	22.8	
	1.5	0.8	1.7	13.2	0.94	10.0	103.0	4.14	12.1	8.6	0.71	0.71	14.5	17.0	
60	2.3	1.4	3.3	13.4	0.94	10.2	103.4	4.16	12.2	8.7	0.71	0.68	14.5	17.8	
	3.5	2.6	6.0	13.7	0.96	10.4	104.2	4.19	12.4	8.9	0.71	0.65	14.6	19.2	
	1.5	0.7	1.6	14.5	0.97	11.2	106.4	4.39	11.1	8.0	0.72	0.77	13.8	14.4	
70	2.3	1.4	3.2	14.7	0.98	11.4	106.9	4.40	11.3	8.1	0.72	0.75	13.8	15.0	
	3.5	2.5	5.8	15.0	1.00	11.6	107.7	4.41	11.5	8.3	0.72	0.71	13.9	16.3	
	1.5	0.7	1.5	15.6	1.03	12.1	109.4	4.45	10.6	7.8	0.73	0.84	13.5	12.6	
80	2.3	1.3	3.0	15.9	1.04	12.3	110.0	4.48	10.9	7.9	0.73	0.80	13.6	13.5	
	3.5	2.5	5.7	16.1	1.05	12.5	110.6	4.50	11.0	8.0	0.73	0.78	13.7	14.1	
	1.5	0.6	1.4	16.7	1.07	13.0	112.1	4.55	10.2	7.5	0.73	0.92	13.4	11.1	
90	2.3	1.3	2.9	16.9	1.09	13.2	112.8	4.56	10.4	7.6	0.74	0.88	13.4	11.8	
	3.5	2.4	5.5	17.2	1.10	13.4	113.5	4.57	10.5	7.7	0.73	0.85	13.4	12.4	
	1.5	0.6	1.3							Operat	ion not rec	ommended			
100	2.3	1.2	2.8						9.7	7.3	0.75	1.00	13.1	9.7	
	3.5	2.3	5.3						9.8	7.4	0.75	0.97	13.1	10.1	
	1.5	0.5	1.2							Operat	ion not rec	ommended			
110	2.3	1.1	2.6	C	Operation not recommended					6.9	0.77	1.11	12.7	8.1	
	3.5	2.2	5.1							7.0	0.77	1.08	12.8	8.4	
	1.5	0.5	1.2							Operat	ion not rec	ommended			
120	2.3	1.1	2.5						8.5	6.7	0.79	1.21	12.6	7.0	
	3.5	2.1	4.9						8.7	6.8	0.78	1.18	12.7	7.4	

Contractor:	P.O.:
Engineer:	
Drainet Name:	Unit Tog



YC15 - Performance Data

450 Rated CFM Heating / Cooling

Performance capacities shown in thousands of Btuh.

	Flow	Wa	ter		HEATIN	G - EAT 7	0 °F				DLING - EA	T 80/67 °F		
°F	Rate GPM	Pressur PSI	e Drop FT/HD	HC kBtuh	Power kW	HE kBtuh	LAT °F	СОР	P TC SC S/T P kBtuh kBtuh Ratio				HR kBtuh	EER
	2.0	1.8	4.1				·	ı	kBtuh kBtuh Ratio kW kBtuh					
20	3.0	3.4	7.8		peration no	ot recomme	ended			Operat	ion not rec	ommended		
	4.5	5.9	13.6	10.7	0.93	7.5	90.0	3.37						
	2.0	1.7	3.9	C	peration no	ot recomme	ended			Operat	ion not rec	ommended		
30	3.0	3.3	7.6	11.8	0.95	8.5	92.2	3.62	17.1	12.2	0.71	0.48	18.7	35.6
	4.5	5.7	13.2	12.3	0.97	9.0	93.3	3.72	17.3	12.4	0.71	0.45	18.9	38.4
	2.0	1.7	3.8	12.7	0.95	9.4	94.1	3.93		Operat	ion not rec	ommended		
40	3.0	3.2	7.5	12.9	0.96	9.6	94.6	3.94	16.7	12.0	0.72	0.60	18.8	27.8
	4.5	5.6	12.9	13.4	0.98	10.1	95.6	4.02	17.0	12.2	0.72	0.57	18.9	30.0
	2.0	1.6	3.7	13.9	0.95	10.6	96.5	4.27	16.2	11.7	0.72	0.75	18.8	21.5
50	3.0	3.2	7.3	14.1	0.97	10.8	97.1	4.28	16.4	11.8	0.72	0.72	18.8	22.6
	4.5	5.5	12.7	14.6	0.99	11.2	97.9	4.31	16.6	12.0	0.72	0.68	18.9	24.4
	2.0	1.6	3.6	15.2	0.96	12.0	99.4	4.66	15.5	11.4	0.74	0.84	18.3	18.3
60	3.0	3.1	7.1	15.6	0.97	12.2	100.0	4.69	15.6	11.5	0.74	0.81	18.4	19.2
	4.5	5.4	12.5	16.1	1.00	12.7	101.0	4.72	15.9	11.8	0.74	0.77	18.5	20.7
	2.0	1.5	3.5	16.6	0.96	13.3	102.2	5.05	14.7	11.1	0.76	0.94	17.9	15.7
70	3.0	3.0	7.0	17.0	0.98	13.7	103.0	5.08	14.9	11.3	0.76	0.90	18.0	16.5
	4.5	5.3	12.2	17.6	1.00	14.1	104.1	5.12	15.2	11.5	0.76	0.86	18.1	17.8
	2.0	1.5	3.4	18.3	1.03	14.8	105.7	5.22	14.2	10.9	0.77	1.00	17.6	14.1
80	3.0	3.0	6.8	18.6	1.04	15.1	106.3	5.24	14.5	11.1	0.77	0.96	17.7	15.1
	4.5	5.2	12.0	18.9	1.05	15.3	106.8	5.26	14.7	11.2	0.76	0.93	17.8	15.8
	2.0	1.4	3.2	19.6	1.07	15.9	108.3	5.35	13.7	10.6	0.77	1.08	17.4	12.7
90	3.0	2.9	6.7	19.9	1.09	16.2	108.9	5.36	13.9	10.8	0.78	1.03	17.4	13.5
	4.5	5.1	11.8	20.2	1.10	16.4	109.5	5.38	14.1	10.9	0.77	1.00	17.5	14.1
	2.0	1.4	3.1							Operat	ion not rec	ommended		
100	3.0	2.8	6.5						13.4	10.5	0.78	1.14	17.3	11.8
	4.5	5.0	11.6						13.6	10.6	0.78	1.10	17.3	12.3
	2.0	1.3	3.0							Operat	ion not rec	ommended		
110	3.0	2.8	6.4	C	Operation not recommended					10.1	0.79	1.23	17.0	10.4
	4.5	4.9 11.3						13.0	10.3	0.79	1.20	17.1	10.8	
	2.0	1.3	2.9							Operat	ion not rec	ommended		
120	3.0	2.7	6.2						11.3	9.2	0.81	1.39	16.0	8.1
	4.5	4.8	11.1						11.5	9.3	0.81	1.35	16.1	8.5

Contractor:	P.O.:
Engineer:	
Drain at Name:	Unit To a



YC18 - Performance Data

500 Rated CFM Heating / Cooling

Performance capacities shown in thousands of Btuh.

	Wa		/ Cooling iter	r HEATING - EAT 70 °F					Performance capacities shown in thousands of Btuh. COOLING - EAT 80/67 °F					
°F	Flow Rate GPM	Pressur PSI	e Drop FT/HD	HC kBtuh	Power kW	HE kBtuh	LAT °F	СОР	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER
	3.0	1.8	4.1		peration no	ot recomme	anded	•		•	•	•	•	•
20	4.0	4.2	9.7		, peration no			Operation not recommended						
	5.5	8.0	18.5	13.0	1.20	8.9	92.0	3.16						
	3.0	1.7	3.9	C	peration no	ot recomme	ended			Operat	ion not rec	ommended		
30	4.0	4.1	9.6	14.2	1.24	10.0	94.3	3.35	22.2	16.0	0.72	0.69	24.6	32.1
	5.5	7.9	18.2	14.3	1.25	10.1	94.5	3.36	22.5	16.3	0.72	0.65	24.7	34.6
	3.0	1.7	3.8	15.5	1.26	11.2	96.7	3.60		Operat	ion not rec	ommended		
40	4.0	4.1	9.4	15.8	1.27	11.5	97.3	3.65	21.3	15.5	0.72	0.79	24.1	26.9
	5.5	7.8	17.9	16.2	1.28	11.8	98.0	3.71	21.7	15.8	0.73	0.75	24.2	29.1
	3.0	1.6	3.7	17.2	1.28	12.8	99.9	3.93	20.3	14.8	0.73	0.93	23.5	21.9
50	4.0	4.0	9.2	17.6	1.29	13.2	100.5	3.98	20.5	14.9	0.73	0.89	23.5	23.0
	5.5	7.6	17.6	18.1	1.31	13.6	101.5	4.05	20.8	15.2	0.73	0.84	23.7	24.8
	3.0	1.6	3.6	19.2	1.30	14.8	103.6	4.33	19.0	13.9	0.73	1.01	22.4	18.7
60	4.0	3.9	9.1	19.7	1.32	15.2	104.4	4.37	19.2	14.1	0.73	0.97	22.5	19.7
	5.5	7.5	17.3	20.3	1.34	15.7	105.6	4.43	19.5	14.4	0.74	0.92	22.6	21.2
	3.0	1.5	3.5	21.3	1.32	16.8	107.4	4.71	17.6	13.1	0.74	1.09	21.3	16.1
70	4.0	3.9	8.9	21.8	1.34	17.2	108.3	4.75	17.8	13.2	0.74	1.06	21.5	16.9
	5.5	7.4	17.1	22.5	1.37	17.8	109.7	4.80	18.2	13.5	0.74	1.00	21.6	18.2
	3.0	1.5	3.4	23.3	1.40	18.6	111.2	4.88	17.1	12.9	0.75	1.25	21.3	13.7
80	4.0	3.8	8.8	23.7	1.41	18.9	111.9	4.92	17.4	13.1	0.75	1.19	21.5	14.7
	5.5	7.3	16.9	24.0	1.43	19.1	112.4	4.93	17.7	13.2	0.75	1.15	21.6	15.3
	3.0	1.4	3.2	24.7	1.44	19.8	113.8	5.03	16.6	12.6	0.76	1.41	21.4	11.8
90	4.0	3.7	8.6	25.1	1.46	20.1	114.5	5.04	16.9	12.8	0.76	1.34	21.5	12.6
	5.5	7.2	16.6	25.5	1.48	20.5	115.2	5.06	17.1	12.9	0.75	1.30	21.5	13.2
	3.0	1.4	3.1		•	•	•	•		Operat	ion not rec	ommended		•
100	4.0	3.7	8.5						16.4	12.5	0.76	1.49	21.5	11.0
	5.5	7.1	16.3	1					16.6	12.6	0.76	1.44	21.5	11.5
	3.0	1.3	3.0	1					Operation not recommended				•	
110	4.0	3.6	8.3	С	peration no	ot recomme	ended		15.8	12.1	0.77	1.62	21.3	9.7
	5.5	6.9	15.9						16.0	12.3	0.77	1.58	21.4	10.1
	3.0	1.3	2.9	.9 Operation not recommended										
120	4.0	3.5	8.2						14.7	11.7	0.80	1.77	20.8	8.3
	5.5	6.8	15.7						15.0	11.9	0.79	1.72	20.9	8.7


Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Wiring Schematics

CCM - with ECM Motor and Electronic Stat

208-230-265/60/1

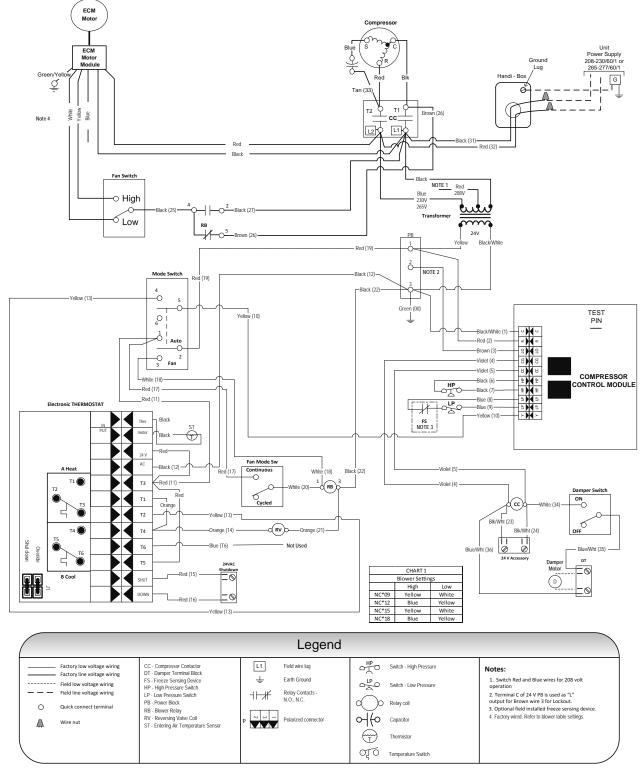


Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:



Wiring Schematics cont.

CCM - with ECM, Electric Heat and Electronic Stat

208-230-265/60/1

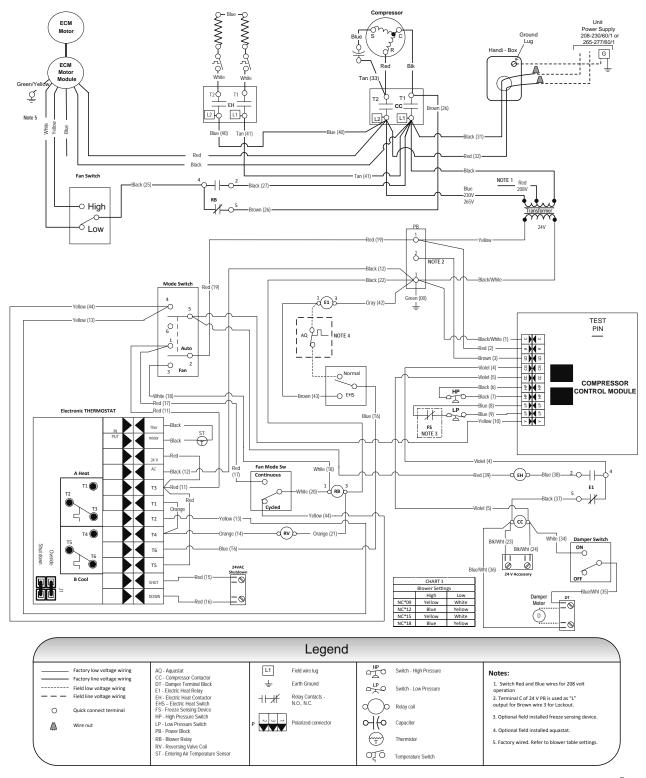


Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Wiring Schematics cont.

ABC - ECM with Electric Heat and Remote Stat

208-230-265/60/1

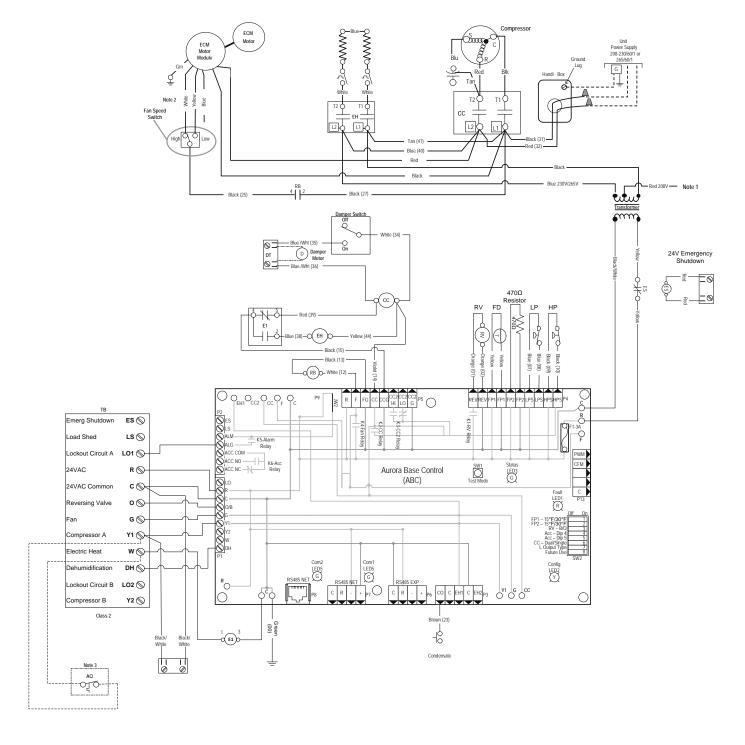

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Wiring Schematics cont.

ABC - ECM with Electric Heat and Remote Stat

208-230-265/60/1

Notes:


- Swap blue and red leads for 208V operation.
 Factory wired. Refer to blower table settings.
 Optional field installed Aquastat for use with single heat.


Aurora Timing Events					
Event	Normal Mode	Test Mode			
Random Start Delay	5 to 80 seconds	1 second			
Compressor On Delay	5 seconds	< 1 second			
Compressor Minimum On Time	2 minutes	5 seconds			
Compressor Short Cycle Delay	4 minutes	15 seconds			
Blower Off Delay	30 seconds	2 seconds			
Fault Recognition Delay - High Pressure	Less than 1 second	Less than 1 second			
Start-Up Bypass – Low Pressure	2 minutes	30 seconds			
Fault Recognition Delay - Low Pressure	30 seconds	30 seconds			
Start-Up Bypass – Low Water/Air Coll Limit	2 minutes	30 seconds			
Fault Recognition Delay - Low Water/Air Coil Limit	30 seconds	30 seconds			
Fault Recognition Delay - Condensate Overflow	30 seconds	30 seconds			
Thermostat Call Recognition Time	2 seconds	2 seconds			
Auxiliary Heat Staging Delay	5 minutes	20 seconds			
Emergency Heat Staging Delay	2 minutes	7.5 seconds			
Water Valve Slow Open Delay	90 seconds	90 seconds			
Reheat Delay	30 seconds	30 seconds			

Accessory Relay						
Operation	SW2-4	SW2-5				
Cycle with Blower	On	On				
Cycle with Compressor	Off	Off				
Water Valve Slow Open	On	Off				

					Aurora LED	Flash Codes			
Slow Flash	1 second o	1 second on and 1 second off							
Fast Flash	100 milliser	100 milliseconds on and 100 milliseconds off							
Flash Code	100 milliser	100 milliseconds on and 400 milliseconds off with a 2 second pause before repeating							
	Random St	art Delay							
Status LED (LE	D1, Green)		Fas	t Flash					
Configuration L	ED (LED2, Ye	ellow)	Fas	t Flash					
Fault LED (LED	3, Red)		Fas	t Flash					
Status	LED (LED1,	Green)		Configuration LED (LED2, Yellow)		LED2, Yellow)	Fault LED (LED3, Red)		
Normal Mode		00		No Software Overide		Flash ECM Setting	Normal Mode	OFF	
Control is Non-	Functional	OF	F	DIP Switch Overide		Slow Flash	Input Fault Lockout	Flash Code	
Test Mode		Slow F	lash	ECM Cor	nfigure Mode	Fast Flash	High Pressure Lockout	Flash Code	
Lockout Active		Fast F	lash	Reset Co	nfigure Mode	Off	Low Pressure Lockout	Flash Code	
Dehumidificatio	n Mode	Flash C	ode 2				Low Air Coil Limit Lockout - FP2	Flash Code	
Reserved		Flash C	ode 3	1			Low Water Coil Limit Lockout - FP1	Flash Code	
Reserved		Flash C	ode 4	1			Reserved	Flash Code	
Load Shed		Flash C	ode 5	1			Condensate Overflow Lockout	Flash Code	
ESD Flash Code 6		I			Over/Under Voltage Shutdown	Flash Code			
Reserved		Flash C	ode 7	1			Reserved	Flash Code	
				•			Reserved	Flash Code 1	
							Air/Water Coil Limit Sensor Error	Flash Code 1	

	CHART 1							
	Blower Settings							
	High Low							
NC*09	Yellow	White						
NC*12	Blue	Yellow						
NC*15	Yellow	White						
NC*18	Blue	Yellow						



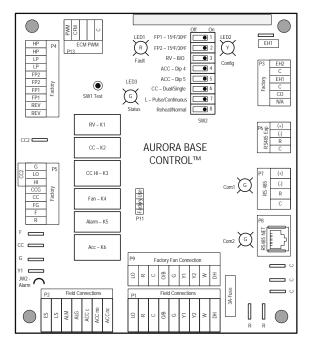


Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:



Wiring Schematics cont.

ABC - with ECM and Electronic Stat

208-230-265/60/1

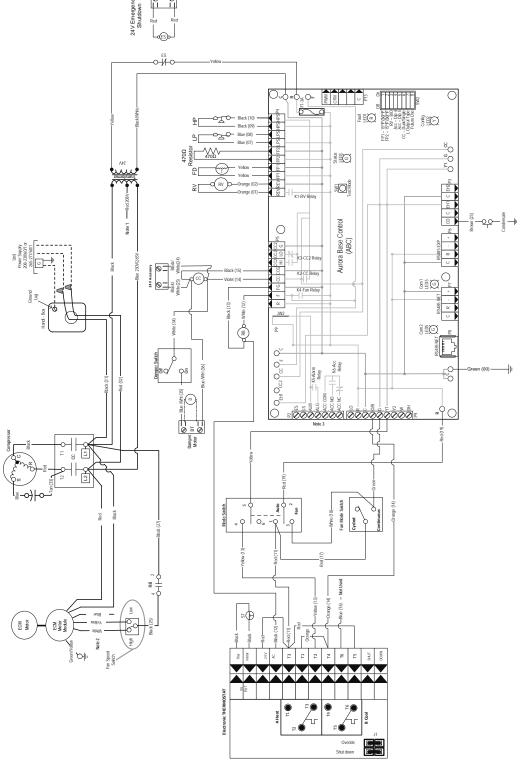

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Wiring Schematics cont.

ABC - with ECM and Electronic Stat

208-230-265/60/1

EH1

Accessory Relay					
Operation	SW2-4	SW2-5			
Cycle with Blower	On	On			
Cycle with Compressor	Off	Off			
Water Valve Slow Open	On	Off			
Outdoor Air Damper	Off	On			


Aurora Timing Events					
Event	Normal Mode	Test Mode			
Random Start Delay	5 to 80 seconds	1 second			
Compressor On Delay	5 seconds	< 1 second			
Compressor Minimum On Time	2 minutes	5 seconds			
Compressor Short Cycle Delay	4 minutes	15 seconds			
Blower Off Delay	30 seconds	2 seconds			
Fault Recognition Delay - High Pressure	Less than 1 second	Less than 1 second			
Start-Up Bypass – Low Pressure	2 minutes	30 seconds			
Fault Recognition Delay - Low Pressure	30 seconds	30 seconds			
Start-Up Bypass - Low Water/Air Coil Limit	2 minutes	30 seconds			
Fault Recognition Delay - Low Water/Air Coil Limit	30 seconds	30 seconds			
Fault Recognition Delay - Condensate Overflow	30 seconds	30 seconds			
Thermostat Call Recognition Time	2 seconds	2 seconds			
Auxiliary Heat Staging Delay	5 minutes	20 seconds			
Emergency Heat Staging Delay	2 minutes	7.5 seconds			
Water Valve Slow Open Delay	90 seconds	90 seconds			
Reheat Delay	30 seconds	30 seconds			

1

2


FP2 - 15°F/30°F

Aurora LED Flash Codes								
Slow Flash 1 second on and 1 second off								
Fast Flash	100 milliseconds on and 100 milliseconds off							
Flash Code	Flash Code 100 milliseconds on and 400 milliseconds off with a 2 second pause before repeating							
Random Start Delay								
Status LED (LED)1, Green)		Fas	t Flash	l			
Configuration LE	D (LED2, Ye	ellow)	Fas	t Flash				
Fault LED (LED3	Red)		Fas	t Flash				
Status	LED (LED1,	Green)		Config	juration LED (LED2, Yellow)		Fault LED (LED3, Red)	
Normal Mode		10	l	No Softw	are Overide	Flash ECM Setting	Normal Mode	OFF
Control is Non-F	unctional	nctional OFF DIP Swite		ch Overide	Slow Flash	Input Fault Lockout	Flash Code 1	
Test Mode	est Mode Slow Flash ECM Con		nfigure Mode	Fast Flash	High Pressure Lockout	Flash Code 2		
Lockout Active	out Active Fast Flash Reset Co		nfigure Mode	Off	Low Pressure Lockout	Flash Code 3		
Dehumidification Mode Flash Code 2				Low Air Coil Limit Lockout - FP2	Flash Code 4			
Reserved	served Flash Code 3				Low Water Coil Limit Lockout - FP1	Flash Code 5		
Reserved		Flash C	ode 4	l			Reserved	Flash Code 6
Load Shed		Flash Code 5				Condensate Overflow Lockout	Flash Code 7	
ESD		Flash C	ode 6				Over/Under Voltage Shutdown	Flash Code 8
Reserved		Flash C	ode 7	l			Reserved	Flash Code 9
				•			Reserved	Flash Code 10
l							Air/Water Coil Limit Sensor Error	Flash Code 11



Notes:

1 - Swap blue and red leads for 208V operation Factory wired. Refer to blower table settings.
 Use ALG Output for 24V lockout.

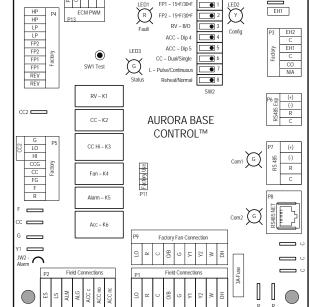

ECM PWM

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Engineering Guide Specifications

General

Furnish and install York Water Source Heat Pumps, as indicated on the plans. Equipment shall be completely assembled, piped and internally wired. Chassis shall be installed with factory built cabinet or other approved custom cabinet. Chassis SHALL NOT be installed without an approved cabinet enclosure. Capacities and characteristics as listed in the schedule and the specifications that follow. The reverse cycle heating/cooling units shall be floor mounted console type with horizontal air inlet and up-flow air discharge. Units shall be AHRI/ISO 13256-1 certified and listed by a nationally recognized safety-testing laboratory or agency, such as ETL Testing Laboratory. Each unit shall be computer run-tested at the factory with conditioned water and operation verified to catalog data. Each unit shall be mounted on a pallet and shipped in a corrugated box or stretch-wrapped. The units shall be designed to operate with entering liquid temperature between 20°F and 120°F [-6.7°C and 48.9°C].

Chassis & Cabinet

The cabinet shall be fabricated from heavy-gauge galvanized steel and finished with a beige textured epoxy powder coating on both sides for added protection. This corrosion protection system shall meet the stringent 1000 hour salt spray test per ASTM B117.

The cabinet shall be easily removable to allow for ease of service to the controls compartment, chassis, and piping. The top of the cabinet and grille is a horizontally flat (optional sloped) surface with a hinged control door cover. The return air filter shall be 1" (25.4 mm) fiberglass disposable type media.

The return and supply air sections are insulated with a 1/4" (6.4 mm) thick, dual density, 2 lb/ft3 (32 kg/m3) coated mat glass fiber with edges sealed or tucked under flanges to prevent the introduction of glass fibers into the discharge supply air through the aluminum grille. Standard cabinet panel insulation must meet NFPA 90A requirements, air erosion and mold growth limits of UL-181, stringent fungal resistance test per ASTM-C1071 and ASTM G21, and shall meet zero level bacteria growth per ASTM G22. Unit insulation must meet these stringent requirements or unit(s) will not be accepted.

Option: A Super Quiet Sound package shall include multi-density full coverage compressor blanket.

Option: Shipped with motorized outside air damper and damper assembly for 25% make-up air.

The drain pan shall be of stainless steel construction to inhibit corrosion and bacterial growth. Drain outlet shall be located on pan as to allow complete and unobstructed drainage of condensate. The unit as standard will be supplied with solid-state electronic condensate overflow protection with Aurora Controls. Mechanical float switches WILL NOT be accepted. Condensate tube shall be constructed of stainless steel and have an internal factory installed condensate trap.

Refrigerant Circuit

All units shall utilize the non-ozone depleting and low global warming potential refrigerant R410A. All units shall contain a sealed refrigerant circuit including a hermetic motor-compressor, bi-directional thermostatic expansion valve, finned tube air-to-refrigerant heat exchanger, reversing valve, coaxial tube water-to-refrigerant heat exchanger, and service ports.

Compressors shall be high-efficiency single speed rotary type designed for heat pump duty and mounted on durometer grommets to provide vibration free compressor mounting. Compressor motors shall be single-phase ECM with internal overload protection.

The air coil shall be sized for low-face velocity and constructed of lanced aluminum fins bonded to rifled aluminum tubes in a staggered pattern not less than three rows deep for enhanced performance.

Option: AlumiSeal electro-coated air coil.

The coaxial water-to-refrigerant heat exchanger shall be designed for low water pressure drop and constructed of a convoluted copper (cupronickel option) inner tube and a steel outer tube. Refrigerant to air heat exchangers shall utilize enhanced corrugated lanced aluminum fins and rifled aluminum tube construction rated to withstand 600 psig (4135 kPa) refrigerant working pressure. Refrigerant-to-water heat exchangers shall be of copper inner water tube and steel refrigerant outer tube design, rated to withstand 600 psig (4135 kPa) working refrigerant pressure and 450 psig (3101 kPa) working water pressure. The thermostatic expansion valve shall provide proper superheat over the entire liquid temperature range with minimal "hunting." The valve shall operate bi-directionally without the use of check valves.

Option: Cupro-nickel refrigerant to water heat exchanger shall be of copper-nickel inner water tube and steel refrigerant outer tube design, rated to withstand 600 PSIG (4135 kPa) working refrigerant pressure and 450 PSIG (3101 kPa) working water pressure. Water lines shall also be of cupronickel construction.

Option: ThermaShield coated water-to-refrigerant heat exchanger, water lines and refrigerant suction lines shall be insulated to prevent condensation at low liquid temperatures below 50°F.

Blower Motor & Assembly

The blower shall be a direct drive centrifugal type with a twin dynamically balanced wheel. The housing and wheel shall be designed for quiet, low outlet velocity operation. The blower housing shall be constructed of galvanized steel and shall be removable from the unit for servicing of the blower motor. The blower motor shall be a two-speed type and shall be isolated from the housing by rubber grommets. The motor shall be permanently lubricated and have thermal overload protection.

Electrical

A control box shall be located within the unit compressor

Contractor:	P.O.:	
Engineer:		
Proiect Name:	Unit Tag:	



Engineering Guide Specifications cont.

compartment and shall contain a 75VA transformer, 24 Volt activated, 2 pole compressor contactor, and solid-state controller for complete unit operation. Units shall be name-plated for use with time delay fuses or HACR circuit breakers. Unit controls shall be 24 Volt and provide heating or cooling as required by the remote thermostat/sensor.

Unit mounted controls shall consist of switches for "OFF", "FAN", and "AUTO" or "HEAT/COOL". An additional switch is provided for blower speed setting of "HI" or "LO". The unit shall be equipped with a blower switch on the side of the control to provide "CONTINUOUS" or "CYCLED" blower operation. "CYCLED" blower will turn the blower on with the compressor. A unit-mounted electronic thermostat with a remote electronic thermistor located in the return air will control compressor operation in heating and cooling modes. Unit mounted thermostat shall be the standard thermostat option. All unit mounted thermostats shall be auto changeover. Manual changeover WILL NOT be accepted. Electromechanical operation WILL NOT be accepted.

Controls

Standard: A compressor control module (CCM) shall be included to disable compressor operation in the event of a trip of any of the safety switches and to send a signal to activate a fault indicator light at the thermostat. The CCM shall be capable of being reset from the thermostat or from the unit main disconnect switch. A terminal block with screw terminals shall be provided for field connection of all low-voltage wiring.

An Aurora microprocessor-based controller that interfaces with a multi-stage electronic thermostat to monitor and control unit operation shall be provided. The control shall provide operational sequencing, blower speed control, high and low pressure switch monitoring, freeze detection, condensate overflow sensing, lockout mode control, LED status and fault indicators, fault memory, field selectable options and accessory output. The control shall provide fault retry three times before locking out to limit nuisance trips. A detachable terminal block with screw terminals will be provided for field control wiring. All units shall have knockouts for entrance of low and line voltage wiring. The blower motor and control box shall be harness plug wired for easy removal.

Option: Remote mounted thermostat is available for CCM and Aurora Base Control. A terminal block with screw terminals will be provided for field control wiring.

Piping

Supply and return water connections shall be 1/2 in. [12.7 mm] FPT copper threaded fittings. All water piping shall be insulated to prevent condensation at low liquid temperatures.

A stainless steel tube stubbed out from the chassis is provided for condensate drain attachment. A short piece of polyvinyl hose is supplied to assist in adapting to drain.

Accessories

Hose Kits - Ball Valves (field-installed)

A flexible steel braid hose featuring Kevlar® reinforced EPDM core with ANSI 302/304 stainless steel outer braid and fire rated materials per ASTM E 84-00 (NFPA 255, ANSI/UL 723 & UBC 8-1). Ball valve at one end; swivel connector with adapter at the other end (swivel to adapter connection via fiber or EPDM gasket). Swivel connection provides union between heat pump and piping system. The hoses feature brass fittings, stainless steel ferrules. A full port ball valve shall be provided with integral P/T (pressure/temperature) port on supply hose. Specifications: Temperature range of 35°F [2°C] to 180°F [82°C]. Max. working pressure of 400 psi [2757 kPa] for 1/2″ and 3/4″ hose kits; max. working pressure of 350 psi [kPa] for 1″ and 1-1/4″ hose kits.

Hose Kits - Automatic Balancing and Ball Valves (field-installed)

A flexible steel braid hose featuring Kevlar® reinforced EPDM core with ANSI 302/304 stainless steel outer braid and fire rated materials per ASTM E 84-00 (NFPA 255, ANSI/UL 723 & UBC 8-1). Ball valve at one end; swivel connector with adapter at the other end (swivel to adapter connection via fiber or EPDM gasket). Swivel connection provides union between heat pump and piping system. The hoses feature brass fittings, stainless steel ferrules. A full port ball valve shall be provided with integral P/T (pressure/temperature) port on supply hose and automatic balancing valve with integral P/T ports and full port ball valve on return hose. Specifications:

- Temperature range of 35°F [2°C] to 180°F [82°C].
- Max. working pressure of 400 psi [2757 kPa] for 1/2" and 3/4" hose kits; max. working pressure of 350 psi [2413 kPa] for 1" and 1-1/4" hose kits.
- Minimum burst pressure of four times working pressure.

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Engineering Guide Specifications cont.

Hose Kits – Automatic Balancing and Ball Valves with 'Y' strainer (field-installed)

A flexible steel braid hose featuring Kevlar® reinforced EPDM core with ANSI 302/304 stainless steel outer braid and fire rated materials per ASTM E 84-00 (NFPA 255, ANSI/UL 723 & UBC 8-1). Ball valve at one end; swivel connector with adapter at the other end (swivel to adapter connection via fiber or EPDM gasket). Swivel connection provides union between heat pump and piping system. The hoses feature brass fittings, stainless steel ferrules. A "y" strainer is provided on one end for fluid straining and integral "blowdown" valve.. A full port ball valve shall be provided with integral P/T (pressure/temperature) port on supply hose and automatic balancing valve with integral P/T ports and full port ball valve on return hose.

Specifications:

- Temperature range of 35°F [2°C] to 180°F [82°C].
- Max. working pressure of 400 psi [2757 kPa] for 1/2" and 3/4" hose kits; max. working pressure of 350 psi [2413 kPa] for 1" and 1-1/4" hose kits.
- Minimum burst pressure of four times working pressure.

Auxiliary Heater (field-installed 208-230V units only)

An electric resistance heater shall provide supplemental and/ or emergency heating capability. A manual switch shall be mounted on the side of the control compartment with "NORMAL" or "BOILERLESS" mode. "NORMAL" will run the compressor when there is a call for heating or cooling. "BOILERLESS" mode operation will run electric heat whenever there is a call for heating and run the compressor for a cooling call.

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Revision Guide

Pages:	Description:	Date:	Ву:
All	Updated Nomenclature and Wiring Schematics (ABC Controls)	1 Sept 2015	MA
All	Obsoleted PSC Option, Updated Nomenclature, Updated Wiring Schematics	04 Mar 2015	MA
All	Updated with All-Aluminum Air Coils	10 Mar 2014	DS
All	First Published	30 Oct 2013	DS