



Heating and Air Conditioning

***SUBMITTAL SET***

**AFFINITY**

**GEOTHERMAL HEAT PUMPS**

**VARIABLE SPEED**

**MODELS:**

**YAFV036 - 060**

**(3 THRU 5 NOMINAL TONS)**



Due to continuous product improvement, specifications are subject to change without notice.

Visit us on the web at [www.york-geothermal.com](http://www.york-geothermal.com)

Additional rating information can found at [www.ahridirectory.org](http://www.ahridirectory.org)

FOR DISTRIBUTION USE ONLY - NOT TO BE USED AT POINT OF RETAIL SALE




Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_

## Model Nomenclature

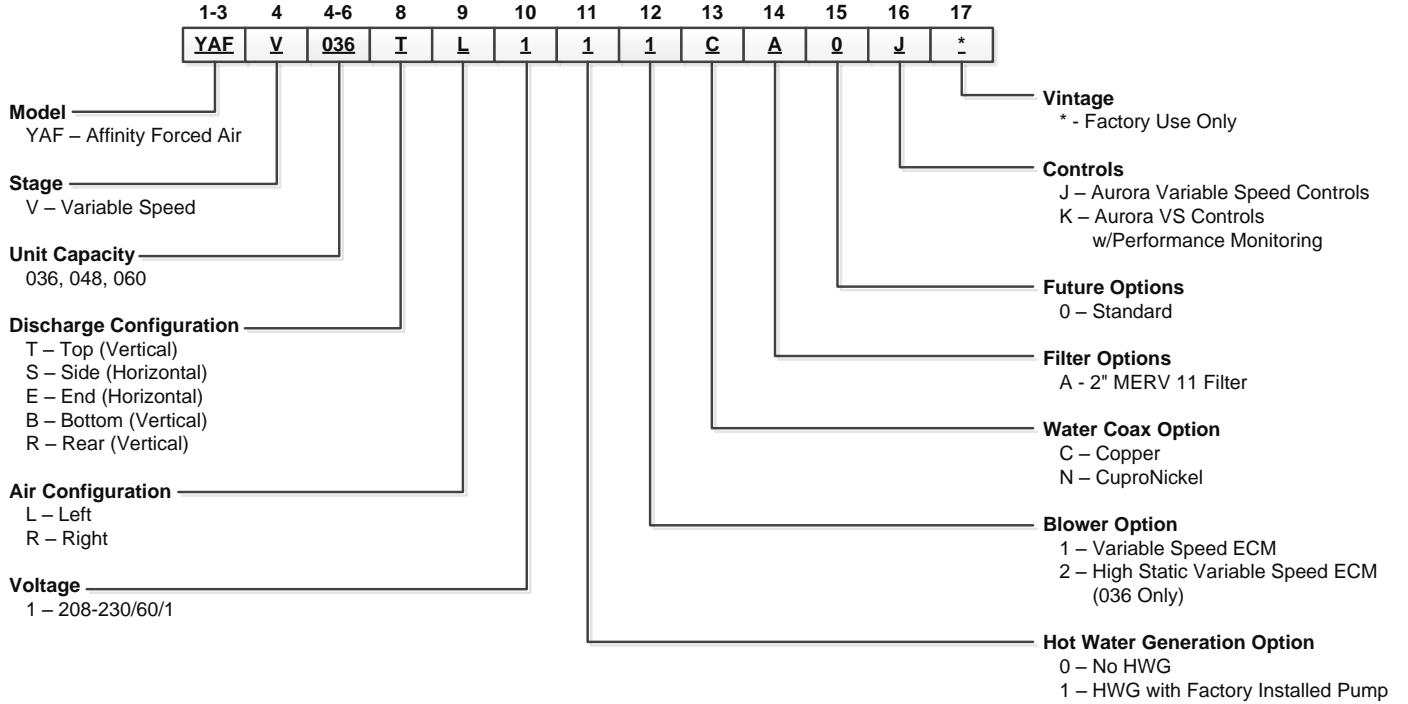

Rev.: 03 March 2015D

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## AHRI/ISO 13256-1 Performance Ratings

### Variable Speed ECM Motor

AHR/ASHRAE/ISO 13256-1

English (IP) Units

Model	Capacity Modulation	Airflow Cfg/Htg  CFM	Water Loop Heat Pump				Ground Water Heat Pump				Ground Loop Heat Pump			
			Cooling EWT 86°F		Heating EWT 68°F		Cooling EWT 59°F		Heating EWT 50°F		Cooling Full Load 77°F Part Load 68°F		Heating Full Load 32°F Part Load 41°F	
			Capacity Btu/h	EER Btu/h per W	Capacity Btu/h	COP	Capacity Btu/h	EER Btu/h per W	Capacity Btu/h	COP	Capacity Btu/h	EER Btu/h per W	Capacity Btu/h	COP
036	Full	1300/1500	32,000	18.0	50,000	5.3	38,000	31.5	41,000	4.6	36,000	22.0	32,000	3.5
	Part		11,000	21.0	17,000	7.5	13,000	47.2	14,000	5.9	14,000	37.0	13,000	5.3
048	Full	1500/1800	41,000	17.6	67,000	5.0	49,000	31.7	55,000	4.3	46,000	21.7	43,000	3.6
	Part		16,000	22.5	24,000	7.6	19,200	53.2	19,000	5.9	19,000	41.0	16,000	5.3
060	Full	1800/2200	50,000	16.3	78,000	4.8	60,000	28.6	65,000	4.3	56,000	19.4	51,000	3.5
	Part		20,000	21.7	29,000	7.5	23,200	45.8	23,000	6.0	23,000	36.0	20,000	5.1

Cooling capacities based upon 80.6°F DB, 66.2°F WB entering air temperature  
Heating capacities based upon 68°F DB, 59°F WB entering air temperature  
All ratings based upon 208V operation

6/15/12

### Energy Star Compliance Table

Model	Tier 3	
	Ground Water	Ground Loop
036	Yes	Yes
048	Yes	Yes
060	Yes	Yes

6/1/12

### Energy Star Rating Criteria

In order for water-source heat pumps to be Energy Star rated they must meet or exceed the minimum efficiency requirements listed below. Tier 3 represents the current minimum efficiency water source heat pumps must have in order to be Energy Star rated.

#### Tier 3: 1/1/2012 – No Effective End Date Published

<b>Water-to-Air</b>	<b>EER</b>	<b>COP</b>
Ground Loop	17.1	3.6
Ground Water	21.1	4.1
<b>Water-to-Water</b>		
Ground Loop	16.1	3.1
Ground Water	20.1	3.5



Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_


Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Vertical Dimensional Data

### Top Air Discharge

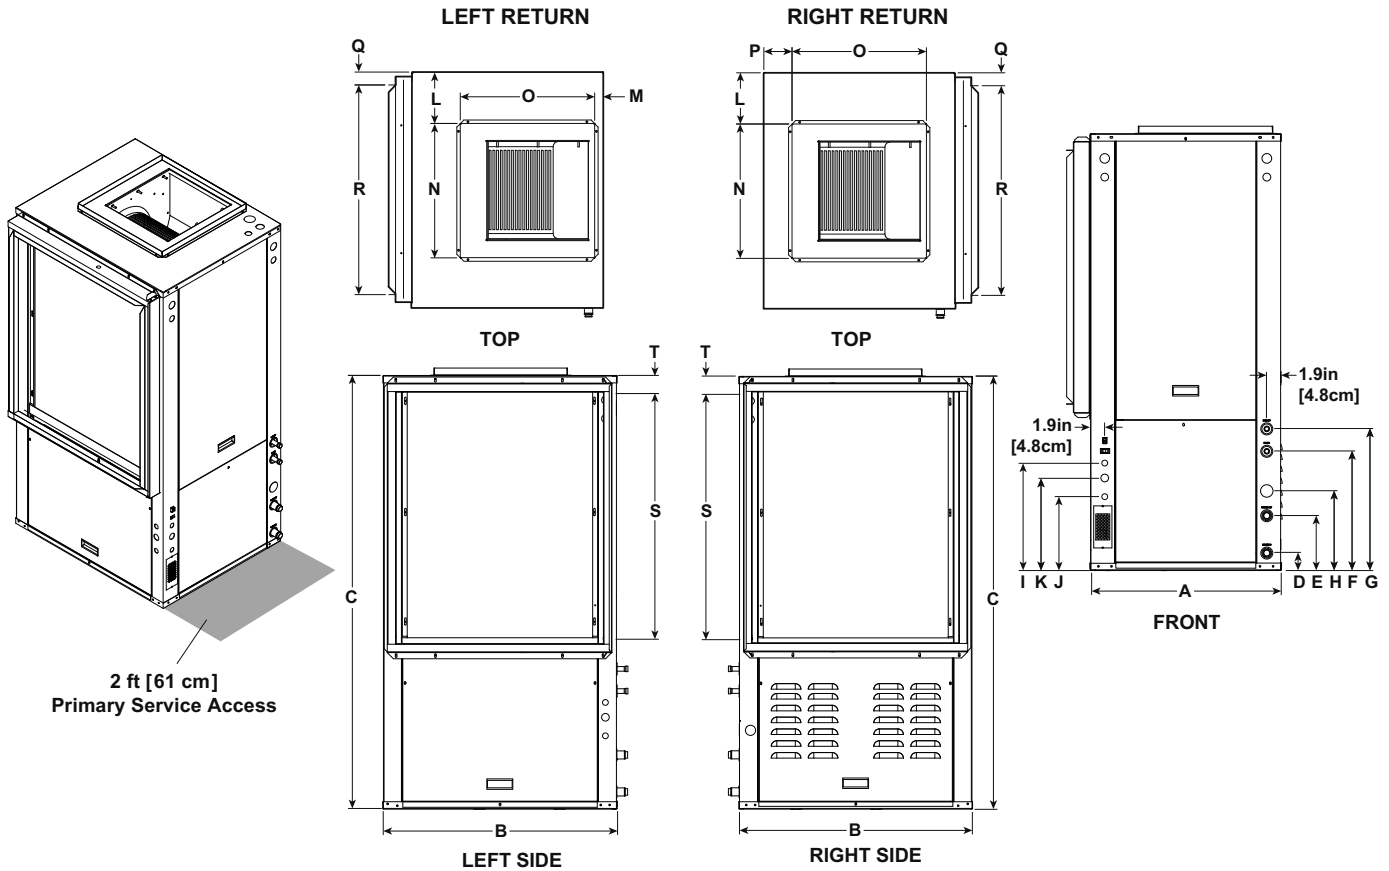

Vertical Top Flow Model	Overall Cabinet			Water Connections							Electrical Connections			Discharge Connection duct flange installed (±0.10 in)					Return Connection using std deluxe filter rack (±0.10 in)				
	A	B	C	D	E	F	G	H	Loop	HWG	I	J	K	L	M	N	O	P	Q	R	S	T	
	Width	Depth	Height	Loop In	Loop Out	HWG In	HWG Out	Condensate	Water FPT	Sweat (I.D.)	1/2 in. cond Low Voltage	1/2 in. cond Ext Pump	3/4 in. cond Power Supply			Supply Width	Supply Depth		Return Depth	Return Height			
036	in.	25.6	31.6	54.4	2.3	7.3	15.9	18.9	10.6	1 in. Swivel	1/2 in. Female	14.3	9.8	12.3	6.9	1.1	18.0	18.0	3.8	1.7	28.1	30.0	1.7
	cm.	65.0	80.3	138.2	5.8	18.5	40.4	48.0	26.9			36.3	24.9	31.2	17.5	2.8	45.7	45.7	9.7	4.3	71.4	76.2	4.3
048	in.	25.6	31.6	54.4	2.3	7.3	15.9	18.9	10.6	1 in. Swivel	1/2 in. Female	14.3	9.8	12.3	6.9	1.1	18.0	18.0	3.8	1.7	28.1	30.0	1.7
	cm.	65.0	80.3	138.2	5.8	18.5	40.4	48.0	26.9			36.3	24.9	31.2	17.5	2.8	45.7	45.7	9.7	4.3	71.4	76.2	4.3
060	in.	25.6	31.6	58.4	2.3	7.3	15.9	18.9	10.6	1 in. Swivel	1/2 in. Female	14.3	9.8	12.3	6.9	1.1	18.0	18.0	3.8	1.7	28.1	34.0	1.7
	cm.	65.0	80.3	148.3	5.8	18.5	40.4	48.0	26.9			36.3	24.9	31.2	17.5	2.8	45.7	45.7	9.7	4.3	71.4	86.4	4.3

Condensate is 3/4 in. PVC female glue socket and is switchable from side to front  
 Unit shipped with deluxe 2 in. (field adjustable to 1 in.) duct collar/filter rack extending from unit 3.25 in. and is suitable for duct connection.  
 Discharge flange is field installed and extends 1 in. [25.4mm] from cabinet  
 Decorative molding and/or water connections extend 1.2 in. [30.5mm] beyond front of cabinet.  
 Louvered vents in the compressor section right side access panel extend 1/2 in. [12.7 mm] from side of cabinet. Allow clearance for venting.  
 Top auxiliary electric heat power knockouts are 1.125", 1.375", and 2".

6/29/12

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_


Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Vertical Dimensional Data cont.

### Bottom Air Discharge

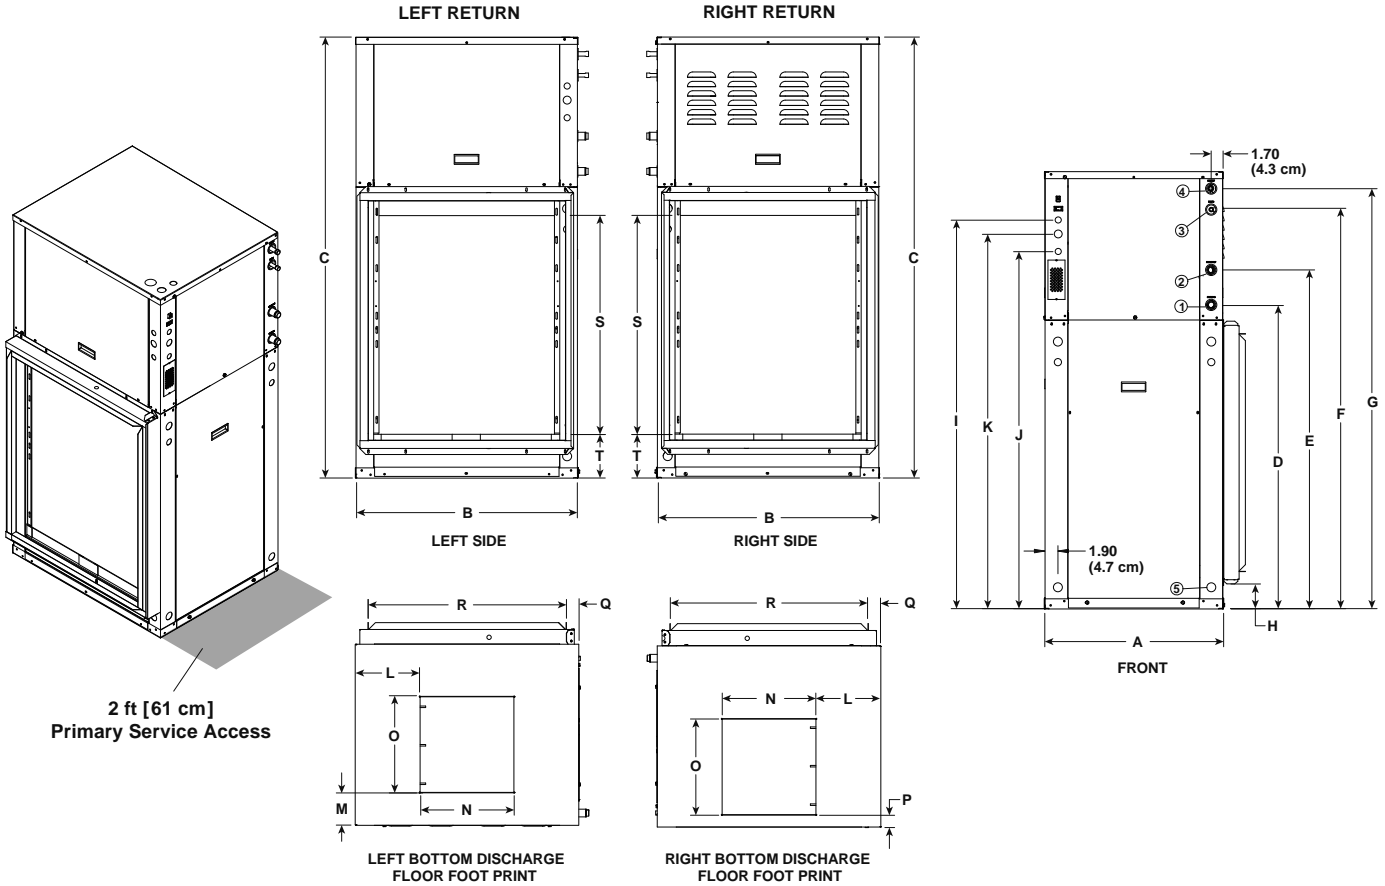

Bottomflow Models	Overall Cabinet			Water Connections							Electrical Knockouts			Discharge Connection duct flange installed (±0.10 in)					Return Connection using std deluxe filter rack (±0.10 in)				
				1	2	3	4	5	Loop Water FPT	HWG Sweat (I.D.)	I 1/2 in. cond	J 1/2 in. cond	K 3/4 in. cond										
	A Width	B Depth	C Height	D In	E Out	F HWG In	G HWG Out	H Condensate	Low Voltage	Ext Pump	Power Supply	L	M	N Supply Width	O Supply Depth	P	Q	R Return Depth	S Return Height	T			
<b>036-060</b>	in.	25.5	31.5	62.5	43.4	48.4	57.0	60.0	3.1	1 in.	1/2 in.	51.1	55.6	53.6	9.1	4.8	13.4	13.6	1.7	1.8	28.1	34.0	5.6
	cm.	64.8	80.0	158.8	110.2	122.9	144.8	152.4	7.9	Swivel	Female	129.8	141.2	136.1	23.1	12.2	34.0	34.5	4.3	4.6	71.4	86.4	14.2

Condensate is 3/4 in. PVC female glue socket and is switchable from side to front

Unit shipped with deluxe 2 in. (field adjustable to 1 in.) duct collar/filter rack extending from unit 3.25 in. and is suitable for duct connection.

Decorative molding and/or water connections extend 1.2 in. [30.5mm] beyond front of cabinet.

Louvered vents in the compressor section right side access panel extend 1/2 in. [12.7 mm] from side of cabinet. Allow clearance for venting.

Top auxiliary electric heat power knockouts are 1.125", 1.375", and 2".

4/30/12

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_


Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_




## Vertical Dimensional Data cont.


### Rear Air Discharge

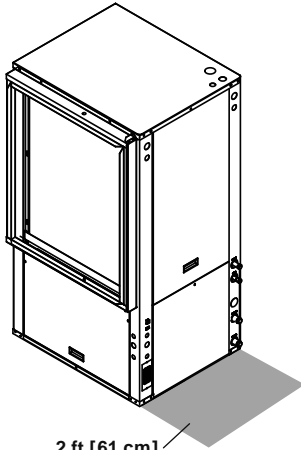


2 ft [61 cm]  
Primary Service Access

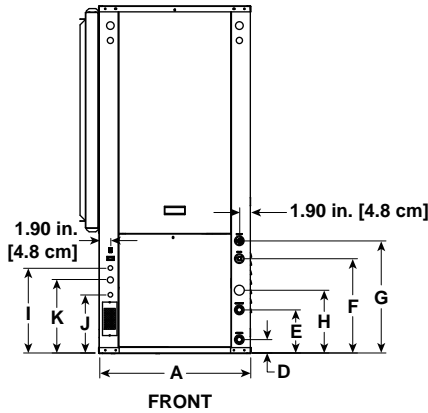


FRONT

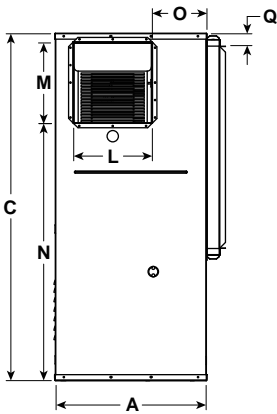


REAR VIEW  
LEFT RETURN

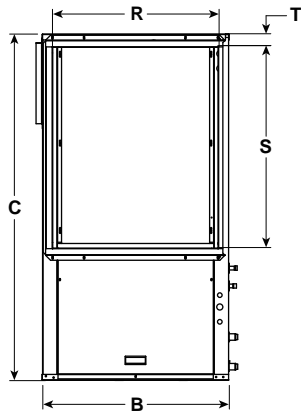

SIDE VIEW  
LEFT RETURN

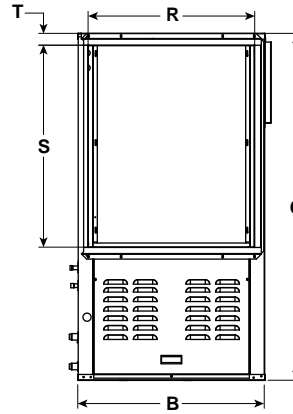

SIDE VIEW  
RIGHT RETURN

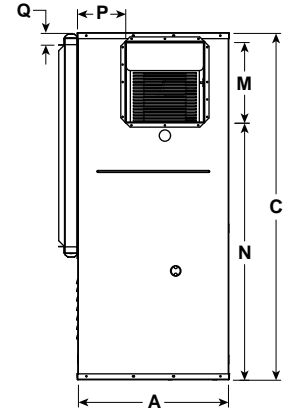

REAR VIEW  
RIGHT RETURN

Vertical Rear Discharge Model	Overall Cabinet			Water Connections							Electrical Connections			Discharge Connection duct flange installed (±0.10 in)					Return Connection using std deluxe filter rack (±0.10 in)				
	A Width	B Depth	C Height	D Loop In	E Loop Out	F HWG In	G HWG Out	H Condensate	Loop Water FPT	HWG Sweat (I.D.)	I 1/2 in. cond Low Voltage	J 1/2 in. cond Ext Pump	K 3/4 in. cond Power Supply	L Supply Width	M Supply Depth	N	O	P	Q	R Return Depth	S Return Height	T	
036	in.	25.6	31.6	54.4	2.3	7.3	15.9	18.9	10.6	1 in. Swivel	1/2 in. Female	14.3	9.8	12.3	13.3	13.6	39.4	9.1	8.1	1.7	28.1	30.0	1.7
	cm.	65.0	80.3	138.2	5.8	18.5	40.4	48.0	26.9	Swivel	Female	36.3	24.9	31.2	33.8	34.5	100.1	23.1	20.6	4.3	71.4	76.2	4.3
048	in.	25.6	31.6	54.4	2.3	7.3	15.9	18.9	10.6	1 in. Swivel	1/2 in. Female	14.3	9.8	12.3	13.3	13.6	39.4	9.1	8.1	1.7	28.1	30.0	1.7
	cm.	65.0	80.3	138.2	5.8	18.5	40.4	48.0	26.9	Swivel	Female	36.3	24.9	31.2	33.8	34.5	100.1	23.1	20.6	4.3	71.4	76.2	4.3
060	in.	25.6	31.6	58.4	2.3	7.3	15.9	18.9	10.6	1 in. Swivel	1/2 in. Female	14.3	9.8	12.3	13.3	13.6	43.4	9.1	8.1	1.7	28.1	34.0	1.7
	cm.	65.0	80.3	148.3	5.8	18.5	40.4	48.0	26.9	Swivel	Female	36.3	24.9	31.2	33.8	34.5	110.2	23.1	20.6	4.3	71.4	86.4	4.3

Condensate is 3/4 in. PVC female glue socket and is switchable from side to front  
 Unit shipped with deluxe 2 in. (field adjustable to 1 in.) duct collar/filter rack extending from unit 3.25 in. and is suitable for duct connection.  
 Discharge flange is field installed and extends 1 in. [25.4mm] from cabinet  
 Decorative molding and/or water connections extend 1.2 in. [30.5mm] beyond front of cabinet.  
 Louvered vents in the compressor section right side access panel extend 1/2 in. [12.7 mm] from side of cabinet. Allow clearance for venting.  
 Top auxiliary electric heat power knockouts are 1.125", 1.375", and 2".

6/29/12


Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



# Horizontal Dimensional Data

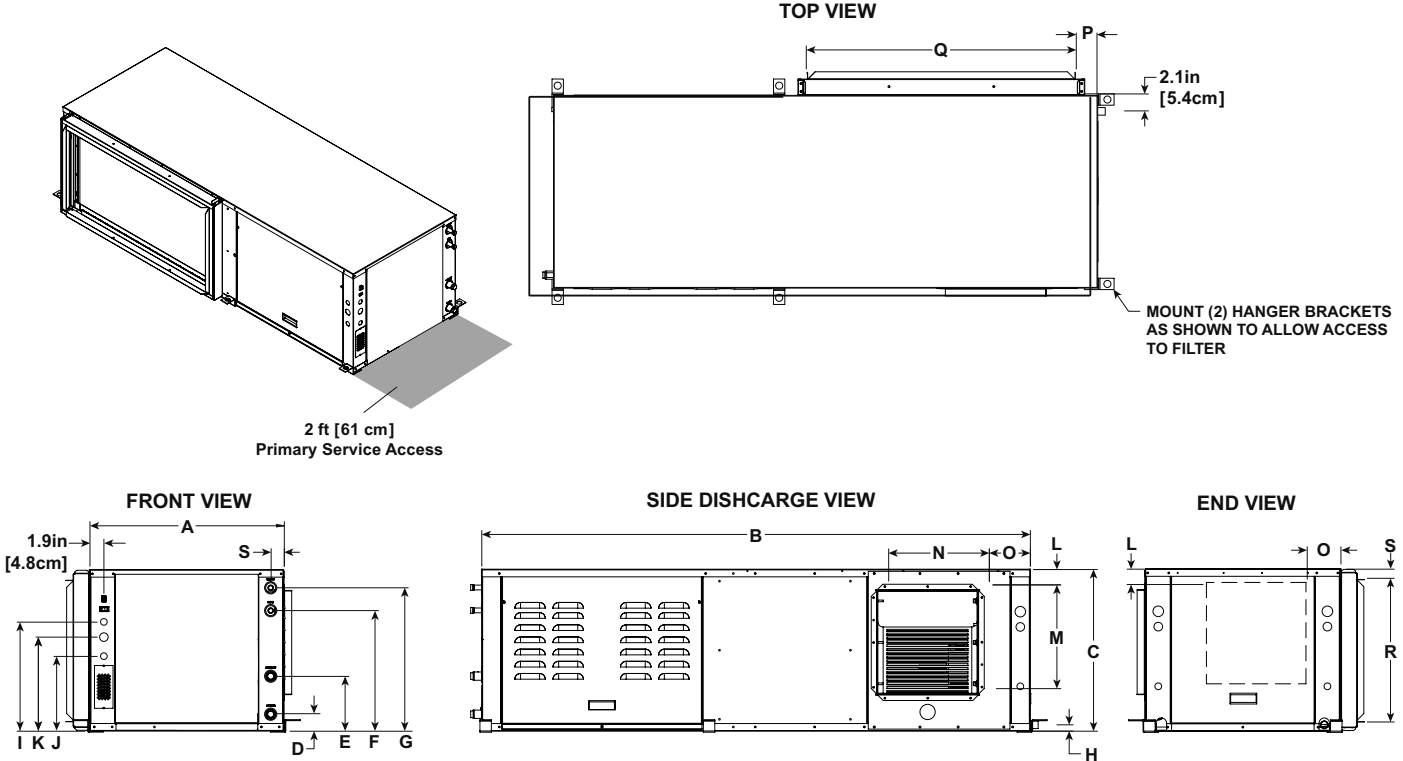

2 ft [61 cm]  
Primary Service Access

AS SHOWN LR UNIT (RR UNIT ON OPPOSITE SIDE—SAME DIMENSIONS)

Horizontal Models	Overall Cabinet			Water Connections							Electrical Connections			Discharge Connection duct flange installed (±0.10 in)				Return Connection using std deluxe filter rack (±0.10 in)				
	A	B	C	D	E	F	G	H	Loop Water FPT	HWG Sweat (I.D.)	I 1/2 in. cond	J 1/2 in. cond	K 3/4 in. cond	L	M Supply Height	N Supply Depth	O	P	Q Return Depth	R Return Height	S	
	Width	Depth	Height	In	Out	HWG In	HWG Out	Condensate			Low Voltage	Ext Pump	Power Supply									
036	in.	25.6	77.0	21.3	2.3	7.3	15.9	18.9	0.8	1 in. Swivel	1/2 in. Female	14.3	9.8	12.3	SEE CHART	13.6	13.2	SEE CHART	2.8	40.4	18.9	1.3
	cm.	65.0	195.6	54.1	5.8	18.5	40.4	48.0	2.0			36.3	24.9	31.2		34.5	33.5		7.1	102.6	48.0	3.3
048	in.	25.6	77.0	21.3	2.3	7.3	15.9	18.9	0.8	1 in. Swivel	1/2 in. Female	14.3	9.8	12.3	SEE CHART	13.6	13.2	SEE CHART	2.8	40.4	18.9	1.3
	cm.	65.0	195.6	54.1	5.8	18.5	40.4	48.0	2.0			36.3	24.9	31.2		34.5	33.5		7.1	102.6	48.0	3.3
060	in.	25.6	82.0	21.3	2.3	7.3	15.9	18.9	0.8	1 in. Swivel	1/2 in. Female	14.3	9.8	12.3	SEE CHART	13.6	13.2	SEE CHART	2.8	45.4	18.9	1.3
	cm.	65.0	208.3	54.1	5.8	18.5	40.4	48.0	2.0			36.3	24.9	31.2		34.5	33.5		7.1	115.3	48.0	3.3

Condensate is 3/4 in. PVC female glue socket and is switchable from side to front  
 Unit shipped with deluxe 2 in. (field adjustable to 1 in.) duct collar/filter rack extending from unit 3.25 in. and is suitable for duct connection.  
 Discharge flange is field installed and extends 1 in. [25.4mm] from cabinet  
 Decorative molding and/or water connections extend 1.2 in. [30.5mm] beyond front of cabinet.  
 Louvered vents in the compressor section right side access panel extend 1/2 in. [12.7 mm] from side of cabinet. Allow clearance for venting.

6/29/12

Units Not Shown Above		L	O
Right Return End Discharge	in	2.8	4.6
	cm	7.1	11.8
Right Return Side Discharge	in	4.9	6.9
	cm	12.4	17.5
Left Return End Discharge	in	4.9	7.6
	cm	12.4	19.4
Left Return Side Discharge	in	2.8	6.9
	cm	7.1	17.5

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Physical Data

Model		Variable Speed		
		036	048	060
Compressor (1 each)		Variable Speed Scroll		
Factory Charge R-410A, oz [kg] Vertical		95 [2.69]	120 [3.40]	140 [3.96]
Factory Charge R-410A, oz [kg] Horizontal		95 [2.69]	136 [3.85]	148 [4.19]
<b>ECM Blower Motor &amp; Blower</b>				
Blower Motor Type/Speeds	ECM	Variable Speed		
Blower Motor- hp [W]	ECM	1/2 [373]	1 [746]	1 [746]
High Static Blower Motor - hp [W]	ECM	1 [746]	n/a	n/a
Blower Wheel Size (Dia x W), in. [mm]	ECM	11 x 10 [279 x 254]	11 x 10 [279 x 254]	11 x 10 [279 x 254]
High Static Blower Wheel Size - [Dia. x W], in. [mm]	ECM	11 x 10 [279 x 254]	n/a	n/a
<b>Coax and Water Piping</b>				
Water Connections Size - Swivel - in [mm]		1 [25.4]	1 [25.4]	1 [25.4]
HWG Connection Size - Female Sweat I.D. - in [mm]		1/2 [12.7]	1/2 [12.7]	1/2 [12.7]
Coax & Piping Water Volume - gal [l]		1.6 [6.1]	1.6 [6.1]	2.3 [8.7]
<b>Vertical</b>				
Air Coil Dimensions (H x W), in. [mm]		32 x 25 [813 x 635]	32 x 25 [813 x 635]	36 x 25 [914 x 635]
Air Coil Total Face Area, ft <sup>2</sup> [m <sup>2</sup> ]		5.6 [0.570]	5.6 [0.570]	6.3 [0.641]
Air Coil Tube Size, in [mm]		3/8 [9.5]	3/8 [9.5]	3/8 [9.5]
Air Coil Number of rows		3	3	4
Filter Standard - 2 in. [51 mm] Pleated MERV 11 Throwaway, in [mm]		32 x 30 [813 x 762]	32 x 30 [813 x 762]	36 x 30 [914 x 762]
Weight - Operating, lb [kg]		352 [160]	361 [164]	385 [175]
Weight - Packaged, lb [kg]		372 [169]	381 [173]	405 [184]
<b>Horizontal</b>				
Air Coil Dimensions (H x W), in. [mm]		20 x 40 [508 x 1016]	20 x 40 [508 x 1016]	20 x 45 [508 x 1143]
Air Coil Total Face Area, ft <sup>2</sup> [m <sup>2</sup> ]		5.6 [0.570]	5.6 [0.570]	6.3 [0.641]
Air Coil Tube Size, in [mm]		3/8 [9.5]	3/8 [9.5]	3/8 [9.5]
Air Coil Number of rows		3	3	4
Filter Standard - 2 in. [51 mm] Pleated MERV 11 Throwaway, in [mm]		1 - 20 x 20 [508 x 508] 1 - 20 x 22 [508 x 559]	1 - 20 x 20 [508 x 508] 1 - 20 x 22 [508 x 559]	1 - 20 x 25 [508 x 635] 1 - 20 x 22 [508 x 559]
Weight - Operating, lb [kg]		387 [176]	396 [180]	415 [188]
Weight - Packaged, lb [kg]		417 [189]	426 [193]	445 [202]

6/1/12

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.



Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Auxiliary Heat Ratings

Model	kW		Stages	Btu/h		Min CFM	Model Compatibility		
	208V	230V		208V	230V		036	048	060
EAL(H)10A	7.2	9.6	2	24,600	32,700	1100	•	•	•
EAL(H)15A	10.8	14.4	3	36,900	49,100	1250	•	•	•
EAL(H)20A	14.4	19.2	4	49,200	65,500	1500		•	•

Air flow level for auxiliary heat (Aux) must be above the minimum cfm in this table  
Order the "H" part number when installed on horizontal and vertical rear discharge units

6/1/12

## Auxiliary Heat Electrical Data

Model	Supply Circuit	Heater Amps		Min Circuit Amp		Max Fuse (USA)		Max Fuse (CAN)		Max CKT BRK	
		208 V	240 V	208 V	240 V	208 V	240 V	208 V	240 V	208 V	240 V
EAL(H)10A	Single	34.7	40	53.3	60	60	60	60	60	60	60
EAL(H)15A	Single	52.0	60	75	85	80	90	80	90	70	100
	L1/L2	34.7	40	53.3	60	60	60	60	60	60	60
	L3/L4	17.3	20	21.7	25	25	25	25	25	20	30
EAL(H)20A	Single	69.3	80	96.7	110	100	110	100	110	100	100
	L1/L2	34.7	40	53.3	60	60	60	60	60	60	60
	L3/L4	34.7	40	43.3	50	45	50	45	50	40	50

All heaters rated single phase 60 cycle and include unit fan load  
All fuses type "D" time delay (or HACR circuit breaker in USA)

6/1/12

## Electrical Data

Model	Rated Voltage	Voltage Min/Max	Compressor		Drive		HWG Pump FLA	Ext Loop FLA	Blower Motor FLA	Total Unit FLA	Minimum Circuit Amp	Max Fuse HACR Breaker
			LRA	CMCC	LRA	Internal Breaker						
036	208-230/60/1	187/253	10.2	18.0	22.0	30.0	0.4	5.4	4.0	31.8	37.3	40
*036	208-230/60/1	187/253	10.2	18.0	22.0	30.0	0.4	5.4	7.0	34.8	40.3	45
048	208-230/60/1	187/253	12.0	23.5	28.0	35.0	0.4	5.4	7.0	40.8	47.8	50
060	208-230/60/1	187/253	12.0	30.0	33.0	40.0	0.4	5.4	7.0	45.8	54.1	60

\*With optional 1 hp Variable Speed ECM Motor  
Rated Voltage of 208/230/60/1  
HACR circuit breaker in USA only  
All fuses Class RK-5

3/26/12

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Blower Performance Data

### Variable Speed ECM Blower Motor

Model	Max ESP	Air Flow											
		Speed 1	Speed 2	Speed 3	Speed 4	Speed 5	Speed 6	Speed 7	Speed 8	Speed 9	Speed 10	Speed 11	Speed 12
036	0.50	285	380 G	525 L	675	815	980	1100	1220	1330	1440 H	1540 Aux	1575
036 w/1hp*	0.75	480	565 G	665 L	761	870	1000	1100	1200	1300	1410 H	1520 Aux	1630
048	0.75	475	620 G	730 L	850	1020	1140	1270	1400	1520	1650 H	1790 Aux	1925
060	0.75	400	600 G	830 L	1050	1230	1400	1560	1700	1870	2010 H	2140 Aux	2265
<b>**VS Compressor Speed</b>				1-2	3-4		5-6	7-8		9-10	11-12		

\*\* VS Compressor speed is given for the factory default cfm settings. When the cfm default settings are changed it will change the relationship to the compressor speed that is shown in the table. In cooling mode compressor speeds 10-12 are only available when SuperBoost mode is selected at the thermostat. 6/7/12

\* Optional 1 hp Variable Speed ECM

Factory settings are at recommended L, H and Aux positions

"G" may be located anywhere within the airflow table

"L" setting should be located within the boldface cfm range

"H" setting MUST be located within the shaded cfm range

"Aux" setting MUST be equal to or greater than "H" setting

"Aux" setting MUST be equal to or greater than the minimum allowable cfm for the auxiliary heater kit (see auxiliary heat ratings table)

Cfm is controlled within 5% up to the maximum ESP

Max ESP includes allowance for wet coil and standard filter

### Setting Blower Speed - Variable Speed ECM

The ABC board's Yellow Config LED will flash the current ECM blower speed selections for G, low, and high continuously with a short pause in between. The speeds can also be confirmed with the AID Tool under the Setup/ECM Setup screen. The Aux will not be flashed but can be viewed in the AID Tool. The ECM blower motor speeds can be field adjusted with or without using an AID Tool.

### Variable Speed ECM Setup without an AID Tool

The blower speeds for G only, Low (Y1), and High (Y2/Aux) can be adjusted directly at the Aurora ABC board which utilizes the push button (SW1) on the ABC board. This procedure is outlined in the ECM Configuration Mode portion of the Aurora 'Base' Control System section. The Aux cannot be set manually without an AID Tool.


### Variable Speed ECM Setup with an AID Tool

A much easier method utilizes the AID Tool to change the airflow using the procedure below. First navigate to the Setup screen and then select ECM Setup. This screen displays the current ECM settings. It allows the technician to enter the setup screens to change the ECM settings. Change the highlighted item using the ◀ and ▶ buttons and then press the ■ button to select the item.

ECM Speed Info	
Blower Only Speed	3
Lo Compressor	6
Hi Compressor	9
Aux Heat	10
Want To Change?	
Yes	No
Option ◀▶	Enter ■


Selecting YES will enter ECM speed setup, while selecting NO will return to the previous screen.

ECM Speed Setup - These screens allow the technician to select the G, low, high, and auxiliary heat blower speed for the ECM blower motor. Change the highlighted item using the ▲ and ▼ buttons. Press the ■ button to select the speed.

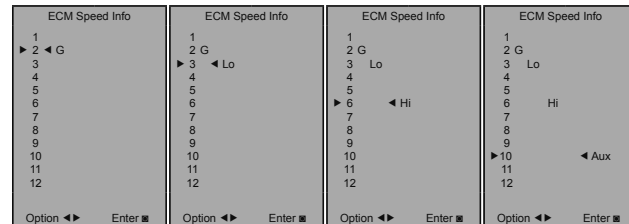

After the auxiliary heat speed setting is selected the AID Tool will automatically transfer back to the ECM Setup screen.

Cooling Airflow Setup - These screens allow the technician to select -15%, -10%, -5%, None or +5% change from the heating airflow. Change the adjustment percentage using the ▲ and ▼ buttons. Press the ■ button to save the change.

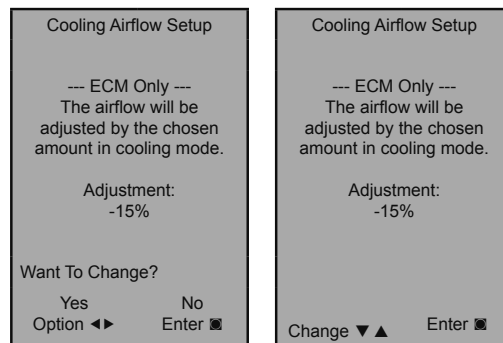

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Operating Limits

Operating Limits	Cooling		Heating	
	(°F)	(°C)	(°F)	(°C)
<b>Air Limits</b>				
Min. Ambient Air	45	7.2	45	7.2
Rated Ambient Air	80	26.7	70	21.1
Max. Ambient Air	100	37.8	85	29.4
Min. Entering Air	50	10.0	40	4.4
Rated Entering Air db/wb	80.6/66.2	27/19	68	20.0
Max. Entering Air db/wb	110/83	43/28.3	80	26.7
<b>Water Limits</b>				
Min. Entering Water	30	-1.1	20	-6.7
Normal Entering Water	50-110	10-43.3	30-70	-1.1
Max. Entering Water	120	48.9	90	32.2

**NOTE:** Minimum/maximum limits are only for start-up conditions, and are meant for bringing the space up to occupancy temperature. Units are not designed to operate at the minimum/maximum conditions on a regular basis. The operating limits are dependent upon three primary factors: 1) water temperature, 2) return air temperature, and 3) ambient temperature. When any of the factors are at the minimum or maximum levels, the other two factors must be at the normal level for proper and reliable unit operation.

## Definitions

### Abbreviations and Definitions

cfm = airflow, cubic feet/minute  
 EWT = entering water temperature, Fahrenheit  
 gpm = water flow in gallons/minute  
 WPD = water pressure drop, psi and feet of water  
 EAT = entering air temperature, Fahrenheit (dry bulb/wet bulb)  
 HC = air heating capacity, MBtu/h  
 TC = total cooling capacity, MBtu/h  
 SC = sensible cooling capacity, MBtu/h  
 kW = total power unit input, kilowatts  
 HR = total heat of rejection, MBtu/h  
 HE = total heat of extraction, MBtu/h

HWC = hot water generator capacity, MBtu/h  
 EER = Energy Efficient Ratio  
 = Btu output/Watt input  
 COP = Coefficient of Performance  
 = Btu output/Btu input  
 LWT = leaving water temperature, °F  
 LAT = leaving air temperature, °F  
 TH = total heating capacity, MBtu/h  
 LC = latent cooling capacity, MBtu/h  
 S/T = sensible to total cooling ratio

## Pressure Drop

Model	gpm	Pressure Drop (psi)				
		30° F	50° F	70°	90° F	110° F
36	11.5	3.40	3.20	3.00	2.80	2.60
	9.0	2.70	2.60	2.40	2.20	2.10
	7.0	1.65	1.55	1.45	1.35	1.25
	5.5	1.10	1.00	0.90	0.85	0.75
	4.5	0.68	0.64	0.60	0.55	0.51
48	13.5	4.60	4.40	4.10	3.80	3.50
	10.5	2.90	2.70	2.50	2.30	2.20
	7.5	1.70	1.60	1.50	1.40	1.30
	6.0	1.20	1.10	1.00	0.96	0.91
	4.0	0.62	0.61	0.60	0.58	0.56
60	17.0	6.40	6.00	5.60	5.20	4.80
	13.5	4.10	3.80	3.60	3.30	3.10
	9.5	2.20	2.10	2.00	1.80	1.70
	7.5	1.70	1.60	1.50	1.40	1.30
	5.0	0.68	0.62	0.58	0.55	0.53

### Notes to Performance Data Tables

The following notes apply to all performance data tables: Performance ratings are based on 80°F DB/67°F WB EAT for cooling and 70°F DB EAT for heating. Three flow rates are shown for each unit. The lowest flow rate shown is used for geothermal open loop/well water systems with a minimum of 50°F EWT. The middle flow rate shown is the minimum geothermal closed loop flow rate. The highest flow rate shown is optimum for geothermal closed loop systems and the suggested flow rate for boiler/tower applications. The hot water generator numbers are based on a flow rate of 0.4 gpm/ton of rated capacity with an EWT of 90°F. Entering water temperatures below 40°F assumes 15% antifreeze solution. For non-standard EAT conditions, apply the appropriate Correction Factor tables. Interpolation between EWT, gpm, and cfm data is permissible, extrapolation is not.

6/29/12

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Correction Factor Tables

### Air Flow Corrections (Compressor Speeds 1-3)

Airflow		Cooling				Heating		
CFM Per Ton of Clg	% of Nominal	Total Cap	Sens Cap	Power	Heat of Rej	Htg Cap	Power	Heat of Ext
240	60	0.940	0.740	0.967	0.951	0.943	1.106	0.902
275	69	0.950	0.783	0.973	0.959	0.953	1.088	0.918
300	75	0.960	0.827	0.978	0.967	0.962	1.070	0.935
325	81	0.970	0.870	0.984	0.975	0.972	1.053	0.951
350	88	0.980	0.913	0.989	0.984	0.981	1.035	0.967
375	94	0.990	0.957	0.995	0.992	0.991	1.018	0.984
<b>400</b>	<b>100</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>
425	106	1.030	1.022	1.024	1.026	1.009	0.982	1.016
450	113	1.060	1.045	1.048	1.051	1.019	0.965	1.033
475	119	1.091	1.067	1.071	1.077	1.028	0.947	1.049
500	125	1.121	1.089	1.095	1.103	1.038	0.930	1.065
520	130	1.151	1.111	1.110	1.129	1.047	0.912	1.082

6/29/12

### Air Flow Corrections (Compressor Speeds 4-12)

Airflow		Cooling				Heating		
CFM Per Ton of Clg	% of Nominal	Total Cap	Sens Cap	Power	Heat of Rej	Htg Cap	Power	Heat of Ext
240	60	0.928	0.747	0.936	0.929	0.961	1.097	0.938
275	69	0.940	0.789	0.946	0.941	0.967	1.081	0.948
300	75	0.952	0.831	0.957	0.953	0.974	1.064	0.959
325	81	0.964	0.873	0.968	0.965	0.980	1.048	0.969
350	88	0.976	0.916	0.979	0.976	0.987	1.032	0.979
375	94	0.988	0.958	0.989	0.988	0.993	1.016	0.990
<b>400</b>	<b>100</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>
425	106	1.020	1.023	1.004	1.018	1.010	0.966	1.018
450	113	1.056	1.042	1.008	1.035	1.020	0.932	1.036
475	119	1.072	1.079	1.011	1.053	1.029	0.898	1.054
500	125	1.087	1.095	1.015	1.070	1.039	0.865	1.071
520	130	1.099	1.113	1.019	1.088	1.049	0.831	1.089

6/14/12

### Cooling Capacity Corrections

Entering Air WB °F	Total Clg Cap	Sensible Cooling Capacity Multipliers - Entering DB °F										Power Input	Heat of Rejection
		60	65	70	75	80	80.6	85	90	95	100		
55	0.898	0.723	0.866	1.048	1.185	*	*	*	*	*	*	0.985	0.913
60	0.912	0.632	0.880	1.078	1.244	1.260	*	*	*	*	*	0.994	0.927
63	0.945		0.768	0.960	1.150	1.175	*	*	*	*	*	0.996	0.954
65	0.976		0.694	0.881	1.079	1.085	1.270	*	*	*	*	0.997	0.972
66.2	0.983		0.655	0.842	1.040	1.060	1.232	*	*	*	*	0.999	0.986
<b>67</b>	<b>1.000</b>		0.616	0.806	<b>1.000</b>	1.023	1.193	1.330	1.480	*	*	<b>1.000</b>	<b>1.000</b>
70	1.053		0.693	0.879	0.900	0.900	1.075	1.205	1.404	*	*	1.003	1.044
75	1.168			0.687	0.715	0.875	1.040	1.261	1.476	1.476	1.007	1.141	

NOTE: \*Sensible capacity equals total capacity at conditions shown.

4/22/12

### Heating Capacity Corrections

Ent Air DB °F	Heating Corrections		
	Htg Cap	Power	Heat of Ext
45	1.062	0.739	1.158
50	1.050	0.790	1.130
55	1.037	0.842	1.096
60	1.025	0.893	1.064
65	1.012	0.945	1.030
68	1.005	0.976	1.012
<b>70</b>	<b>1.000</b>	<b>1.000</b>	<b>1.000</b>
75	0.987	1.048	0.970
80	0.975	1.099	0.930

11/10/09

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Antifreeze Corrections

Catalog performance can be corrected for antifreeze use. Please use the following table and note the example given.

Antifreeze Type	Antifreeze % by wt	Heating	Cooling	Pressure Drop
EWT - °F [°C]		30 [-1.1]	90 [32.2]	30 [-1.1]
Water	0	1.000	1.000	1.000
Ethylene Glycol	10	0.973	0.991	1.075
	20	0.943	0.979	1.163
	30	0.917	0.965	1.225
	40	0.890	0.955	1.324
	50	0.865	0.943	1.419
Propylene Glycol	10	0.958	0.981	1.130
	20	0.913	0.969	1.270
	30	0.854	0.950	1.433
	40	0.813	0.937	1.614
	50	0.770	0.922	1.816
Ethanol	10	0.927	0.991	1.242
	20	0.887	0.972	1.343
	30	0.856	0.947	1.383
	40	0.815	0.930	1.523
	50	0.779	0.911	1.639
Methanol	10	0.957	0.986	1.127
	20	0.924	0.970	1.197
	30	0.895	0.951	1.235
	40	0.863	0.936	1.323
	50	0.833	0.920	1.399



**WARNING:** Gray area represents antifreeze concentrations greater than 35% by weight and should be avoided due to the extreme performance penalty they represent.

### Antifreeze Correction Example

Antifreeze solution is Propylene Glycol 20% by weight. Determine the corrected heating and cooling performance at 30°F and 90°F respectively as well as pressure drop at 30°F for Model 036 operating at 100% capacity.

The corrected cooling capacity at 90°F would be: 35,200 MBtu/h x 0.969 = 34,109 MBtu/h

The corrected heating capacity at 30°F would be: 37,400 MBtu/h x 0.913 = 34,146 MBtu/h

The corrected pressure drop at 30°F and 11.5 gpm would be: 7.9 feet of head x 1.270 = 10.03 feet of head

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



# Performance Data

## 036 - 50% Part Load

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							EWT °F	Flow gpm	WPD		COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC MBtuh	Power kW	HE MBtuh	LAT °F	COP	HWC MBtuh			PSI	FT	Airflow cfm	TC MBtuh	SC MBtuh	S/T Ratio	Power kW	HR M Btuh	EER	HWC MBtuh
20	3.0	0.30	0.7	Operation not recommended							20	2.5	0.15	0.4	Operation not recommended							
	4.5	0.70	1.6	Operation not recommended								3.5	0.46	1.1	Operation not recommended							
	5.5	1.09	2.5	550	14.4	1.24	10.2	94.3	3.41	2.2		5.0	0.77	1.8	Operation not recommended							
30	3.0	0.30	0.7	550	16.5	1.30	12.0	97.7	3.71	2.3	30	2.5	0.15	0.3	500	21.4	14.9	0.70	0.56	23.3	38.3	-
				750	16.7	1.32	12.2	90.6	3.69	2.0					650	20.9	14.8	0.71	0.62	23.0	33.9	-
	4.5	0.68	1.6	550	17.3	1.34	12.7	99.1	3.79	2.6	3.5	0.45	1.0	500	21.3	14.9	0.70	0.54	23.2	39.6	-	
				750	17.7	1.35	13.1	91.8	3.84	2.2				650	20.7	15.4	0.74	0.65	22.9	31.7	-	
	5.5	1.06	2.4	550	17.7	1.35	13.1	99.7	3.84	2.7	5.0	0.75	1.7	500	21.7	15.3	0.71	0.53	23.5	40.7	-	
				750	17.9	1.36	13.3	92.1	3.86	2.2				650	21.0	15.2	0.72	0.61	23.1	34.4	-	
40	3.0	0.29	0.7	550	18.5	1.35	13.9	101.1	4.03	2.5	40	2.5	0.14	0.3	500	24.8	16.3	0.66	0.66	27.1	37.3	-
				750	18.8	1.36	14.2	93.2	4.06	2.2					650	24.7	16.7	0.67	0.74	27.3	33.4	-
	4.5	0.66	1.5	550	19.4	1.38	14.7	102.7	4.13	2.8	3.5	0.44	1.0	500	24.8	16.3	0.66	0.64	27.0	38.7	-	
				750	19.8	1.38	15.1	94.5	4.20	2.3				650	24.6	17.0	0.69	0.75	27.2	32.8	-	
	5.5	1.02	2.4	550	19.8	1.39	15.0	103.3	4.15	2.8	5.0	0.73	1.7	500	25.1	16.5	0.66	0.64	27.3	39.4	-	
				750	20.1	1.39	15.4	94.9	4.23	2.4				650	24.9	17.0	0.68	0.71	27.3	35.1	-	
50	3.0	0.28	0.6	550	20.5	1.45	15.6	104.6	4.16	2.8	50	2.5	0.14	0.3	500	28.4	17.8	0.63	0.77	31.1	36.7	-
				750	21.0	1.45	16.0	95.9	4.24	2.3					650	28.5	18.5	0.65	0.87	31.5	32.9	-
	4.5	0.64	1.5	550	21.6	1.48	16.5	106.3	4.27	3.0	3.5	0.42	1.0	500	28.5	17.9	0.63	0.75	31.0	38.1	-	
				750	22.0	1.48	16.9	97.1	4.36	2.5				650	28.5	18.7	0.66	0.85	31.4	33.5	-	
	5.5	0.99	2.3	550	21.9	1.50	16.8	106.8	4.27	3.1	5.0	0.70	1.6	500	28.8	18.0	0.62	0.74	31.3	38.7	-	
				750	22.4	1.49	17.3	97.7	4.41	2.8				650	28.8	18.7	0.65	0.81	31.6	35.6	-	
60	3.0	0.27	0.6	550	23.0	1.42	18.2	108.8	4.75	3.0	60	2.5	0.13	0.3	500	24.1	16.3	0.68	0.83	27.0	29.1	1.0
				750	23.5	1.41	18.7	99.1	4.91	2.5					650	24.7	17.3	0.70	0.91	27.8	27.2	1.0
	4.5	0.62	1.4	550	24.1	1.45	19.2	110.6	4.88	3.2	3.5	0.41	0.9	500	24.2	16.4	0.68	0.80	27.0	30.3	1.1	
				750	24.7	1.44	19.8	100.5	5.03	2.7				650	24.8	17.4	0.70	0.88	27.8	28.1	1.1	
	5.5	0.96	2.2	550	24.5	1.47	19.5	111.3	4.89	3.3	5.0	0.68	1.6	500	24.5	16.5	0.67	0.79	27.2	30.9	1.2	
				750	25.1	1.45	20.2	101.0	5.08	2.8				650	25.0	17.5	0.70	0.85	27.9	29.4	1.2	
70	3.0	0.26	0.6	550	25.3	1.35	20.7	112.6	5.48	3.2	70	2.5	0.13	0.3	500	20.0	14.8	0.74	0.88	23.0	22.6	1.3
				750	25.9	1.37	21.2	102.0	5.54	2.6					650	18.9	14.7	0.78	0.91	22.0	20.8	1.3
	4.5	0.60	1.4	550	26.4	1.38	21.7	114.4	5.61	3.4	3.5	0.40	0.9	500	20.1	14.9	0.74	0.85	23.0	23.6	1.4	
				750	27.2	1.36	22.6	103.6	5.86	2.9				650	21.1	16.1	0.76	0.92	24.2	23.0	1.4	
	5.5	0.93	2.1	550	26.5	1.55	21.2	114.6	5.01	3.5	5.0	0.66	1.5	500	19.9	14.0	0.70	0.86	22.9	23.2	1.5	
				750	27.6	1.37	22.9	104.1	5.91	2.9				650	21.1	16.3	0.77	0.89	24.1	23.7	1.5	
80	3.0	0.25	0.6	550	27.2	1.43	22.3	115.8	5.57	3.4	80	2.5	0.13	0.3	500	19.2	14.6	0.76	1.05	22.8	18.3	1.9
				750	28.0	1.39	23.2	104.5	5.88	2.8					650	19.8	15.6	0.79	1.12	23.6	17.6	2.0
	4.5	0.57	1.3	550	28.4	1.46	23.4	117.8	5.69	3.6	3.5	0.38	0.9	500	19.4	14.7	0.76	1.01	22.8	19.1	2.1	
				750	29.3	1.43	24.4	106.2	6.03	3.0				650	20.0	15.6	0.78	1.07	23.6	18.6	2.1	
	5.5	0.90	2.1	550	28.9	1.48	23.8	118.6	5.72	3.8	5.0	0.64	1.5	500	19.6	14.8	0.76	1.00	23.0	19.6	2.2	
				750	29.8	1.44	24.9	106.8	6.07	3.2				650	20.1	15.7	0.79	1.04	23.6	19.3	2.5	
90	3.0	0.24	0.6	550	29.1	1.44	24.2	119.0	5.92	3.6	90	2.5	0.12	0.3	500	18.5	14.3	0.77	1.22	22.7	15.1	2.6
				750	30.1	1.40	25.3	107.1	6.31	2.9					650	18.6	15.0	0.81	1.30	23.0	14.4	2.6
	4.5	0.55	1.3	550	30.4	1.47	25.3	121.1	6.03	3.8	3.5	0.37	0.9	500	18.6	14.4	0.78	1.18	22.6	15.8	2.7	
				750	31.4	1.42	26.6	108.8	6.47	3.2				650	18.8	15.0	0.80	1.23	23.0	15.3	2.7	
	5.5	0.87	2.0	550	30.8	1.49	25.7	121.9	6.06	4.1	5.0	0.61	1.4	500	18.8	14.6	0.78	1.15	22.7	16.3	2.8	
				750	32.0	1.44	27.1	109.5	6.51	3.4				650	19.0	15.2	0.80	1.19	23.1	16.0	2.8	
100	3.0	0.23	0.5	Operation not recommended							100	2.5	0.12	0.3	500	16.6	13.5	0.81	1.39	21.4	11.9	3.1
	4.5	0.53	1.2	Operation not recommended								3.5	0.35	0.8	500	16.8	14.1	0.84	1.44	21.7	11.7	3.1
	5.5	0.84	1.9	Operation not recommended								5.0	0.59	1.4	500	16.8	13.6	0.81	1.33	21.3	12.6	3.2
110	3.0	0.22	0.5	Operation not recommended							110	2.5	0.11	0.3	500	14.7	12.6	0.86	1.56	20.1	9.5	3.0
				650	14.9	13.1	0.88	1.57	20.3	9.5					3.0							
	4.5	0.51	1.2	Operation not recommended							3.5	0.34	0.8	500	14.9	12.8	0.86	1.49	20.0	10.0	3.3	
				650	15.0	13.3	0.89	1.51	20.2	10.0				3.2								
	5.5	0.80	1.9	Operation not recommended							5.0	0.57	1.3	500	15.0	13.0	0.86	1.46	20.0	10.3	3.4	
				650	15.2	13.5	0.89	1.47	20.2	10.3				3.4								
120	3.0	0.22	0.5	Operation not recommended							120	2.5	0.11	0.2	500	13.2	11.3	0.86	1.81	19.4	7.3	4.3
				650	13.0	11.3	0.87	1.75	18.9	7.4					4.4							
	4.5	0.49	1.1	Operation not recommended							3.5	0.33	0.8	500	13.3	11.5	0.86	1.74	19.3	7.7	4.4	
				650	13.1	11.7	0.89	1.74	19.0	7.5				4.4								
	5.5	0.77	1.8	Operation not recommended							5.0	0.55	1.3	500	13.6	11.9	0.88	1.67	19.3	8.1	4.6	
				650	13.3	11.8	0.89	1.69	19.1	7.9				4.6								

Performance capacities shown in thousands of Btuh.

7/30/15

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



# Performance Data cont.

## 036 - 100% Full Load

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							EWT °F	Flow gpm	WPD		COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC MBtuh	Power kW	HE MBtuh	LAT °F	COP	HWC MBtuh			PSI	FT	Airflow cfm	TC MBtuh	SC MBtuh	S/T Ratio	Power kW	HR MBtuh	EER	HWC MBtuh
20	5.5	1.09	2.5	Operation not recommended							20	4.5	0.70	1.6	Operation not recommended							
	8.0	2.69	6.2									7.0	1.70	3.9								
	11.5	3.51	8.1	1150	31.6	2.84	21.9	95.4	3.26	4.7		9.0	2.81	6.5								
30	5.5	1.06	2.5	1150	35.3	2.74	25.9	98.4	3.77	5.2	30	4.5	0.68	1.6	1000	39.2	27.3	0.70	1.08	42.9	36.4	-
				1500	36.0	2.79	26.4	92.2	3.78	4.8					1300	38.5	27.4	0.71	1.21	42.6	31.9	-
	8.0	2.61	6.0	1150	35.6	2.77	26.1	98.6	3.77	5.3		7.0	1.65	3.8	1000	39.2	27.3	0.70	1.04	42.8	37.6	-
				1500	36.3	2.82	26.7	92.4	3.77	4.8		1300			38.0	28.1	0.74	1.26	42.3	30.1	-	
	11.5	3.41	7.9	1150	36.1	2.92	26.1	99.1	3.62	5.4		9.0	2.73	6.3	1000	39.3	27.5	0.70	1.05	42.9	37.6	-
				1500	37.4	2.89	27.5	93.1	3.79	5.0		1300			38.6	27.8	0.72	1.18	42.6	32.7	-	
40	5.5	1.02	2.4	1150	40.9	2.73	31.6	103.0	4.40	5.6	40	4.5	0.66	1.5	1000	41.5	29.7	0.72	1.23	45.6	33.8	-
				1500	41.5	2.77	32.1	95.6	4.39	5.0					1300	41.3	30.4	0.74	1.37	46.0	30.1	-
	8.0	2.53	5.9	1150	41.3	2.74	32.0	103.3	4.42	5.8		7.0	1.60	3.7	1000	41.5	29.7	0.72	1.18	45.5	35.0	-
				1500	42.3	2.80	32.8	96.1	4.43	5.1		1300			41.1	31.0	0.75	1.39	45.8	29.7	-	
	11.5	3.31	7.6	1150	42.5	2.80	32.9	104.2	4.44	5.9		9.0	2.65	6.1	1000	41.8	29.9	0.71	1.18	45.8	35.4	-
				1500	43.3	2.85	33.6	96.7	4.46	5.2		1300			41.6	30.9	0.74	1.31	46.1	31.8	-	
50	5.5	0.99	2.3	1150	46.0	2.85	36.2	107.0	4.73	6.0	50	4.5	0.64	1.5	1000	44.0	32.3	0.73	1.38	48.7	31.9	-
				1500	46.4	2.88	36.6	98.7	4.72	5.6					1300	44.2	33.6	0.76	1.54	49.4	28.7	-
	8.0	2.46	5.7	1150	46.4	2.84	36.7	107.4	4.79	6.5		7.0	1.55	3.6	1000	44.1	32.4	0.73	1.33	48.6	33.2	-
				1500	47.6	2.91	37.7	99.4	4.80	5.7		1300			44.2	33.9	0.77	1.51	49.3	29.2	-	
	11.5	3.20	7.4	1150	47.5	2.93	37.5	108.2	4.74	6.6		9.0	2.56	5.9	1000	44.5	32.6	0.73	1.32	49.0	33.7	-
				1500	48.5	2.94	38.5	99.9	4.83	6.8		1300			44.6	33.9	0.76	1.44	49.5	31.0	-	
60	5.5	0.93	2.2	1150	50.8	2.87	41.0	110.9	5.18	6.1	60	4.5	0.62	1.4	1000	41.4	31.3	0.76	1.61	46.9	25.7	1.9
				1500	51.6	2.89	41.7	101.9	5.23	5.7					1300	42.4	33.3	0.78	1.77	48.4	24.0	2.0
	8.0	2.38	5.5	1150	52.0	2.88	42.2	111.9	5.29	6.7		7.0	1.50	3.5	1000	41.6	31.5	0.76	1.55	46.9	26.8	2.1
				1500	52.8	2.92	42.8	102.6	5.29	5.8		1300			42.6	33.4	0.78	1.71	48.4	24.8	2.1	
	11.5	3.10	7.2	1150	53.2	2.93	43.2	112.8	5.31	6.9		9.0	2.48	5.7	1000	42.0	31.7	0.75	1.54	47.2	27.3	2.0
				1500	54.3	2.97	44.1	103.5	5.36	6.0		1300			42.8	33.6	0.78	1.65	48.4	25.9	2.2	
70	5.5	0.90	2.1	1150	54.9	2.95	44.8	114.2	5.45	6.6	70	4.5	0.60	1.4	1000	38.9	30.3	0.78	1.85	45.2	21.0	2.7
				1500	56.4	3.00	46.2	104.8	5.51	6.2					1300	36.8	29.7	0.81	1.84	43.1	20.0	2.9
	8.0	2.30	5.3	1150	56.9	3.02	46.6	115.8	5.52	6.9		7.0	1.45	3.4	1000	39.1	30.5	0.78	1.78	45.2	22.0	3.1
				1500	57.9	2.95	47.8	105.7	5.75	6.4		1300			41.0	33.0	0.80	1.92	47.6	21.4	3.1	
	11.5	3.00	6.9	1150	58.7	3.08	48.2	117.3	5.58	7.6		9.0	2.40	5.5	1000	40.2	30.3	0.75	1.75	46.1	23.0	3.2
				1500	60.0	3.01	49.7	107.0	5.84	6.6		1300			41.0	33.3	0.81	1.86	47.4	22.1	3.3	
80	5.5	0.87	0.1	1150	60.2	3.15	49.4	118.4	5.59	7.2	80	4.5	0.57	1.3	1000	36.6	29.9	0.82	2.16	44.0	16.9	4.0
				1500	61.3	3.16	50.5	107.8	5.68	6.1					1300	37.6	31.9	0.85	2.30	45.4	16.3	4.0
	8.0	2.22	5.1	1150	63.0	3.18	52.1	120.7	5.80	7.5		7.0	1.40	3.2	1000	36.8	30.1	0.82	2.07	43.9	17.7	4.2
				1500	63.4	3.17	52.6	109.1	5.85	6.3		1300			37.9	31.9	0.84	2.19	45.4	17.3	4.2	
	11.5	2.90	6.7	1150	63.9	3.23	52.8	121.4	5.79	7.7		9.0	2.32	5.4	1000	37.2	30.4	0.82	2.04	44.1	18.2	4.4
				1500	65.1	3.25	54.0	110.2	5.87	7.2		1300			38.1	32.3	0.85	2.13	45.4	17.9	4.4	
90	5.5	0.84	1.9	1150	64.7	3.35	53.3	122.1	5.66	7.4	90	4.5	0.55	1.3	1000	34.2	29.4	0.86	2.47	42.7	13.9	5.3
				1500	65.8	3.29	54.5	110.6	5.86	6.7					1300	34.5	30.9	0.90	2.62	43.4	13.2	5.3
	8.0	2.14	5.0	1150	68.2	3.41	56.5	124.9	5.86	7.8		7.0	1.35	3.1	1000	34.5	29.7	0.86	2.37	42.6	14.5	5.6
				1500	69.0	3.33	57.6	112.6	6.07	7.2		1300			34.8	30.9	0.89	2.47	43.3	14.1	5.6	
	11.5	2.79	6.5	1150	68.5	3.48	56.6	125.1	5.76	8.6		9.0	2.24	5.2	1000	34.8	30.0	0.86	2.33	42.8	15.0	5.9
				1500	70.3	3.42	58.6	113.4	6.01	7.9		1300			35.2	31.2	0.89	2.40	43.4	14.7	5.6	
100	5.5	0.80	1.8	Operation not recommended							100	4.5	0.53	1.2	1000	32.0	28.1	0.88	2.89	41.8	11.1	6.8
	8.0	2.07	4.8									7.0	1.30	3.0	1300	32.2	28.4	0.88	2.77	41.7	11.6	7.1
	11.5	2.69	6.2									9.0	2.16	5.0	1000	32.6	28.7	0.88	2.71	41.8	12.0	7.5
110	5.5	0.77	1.8	Operation not recommended							110	4.5	0.51	1.2	1000	29.7	26.7	0.90	3.31	41.0	9.0	8.1
	8.0	1.99	4.6									7.0	1.25	2.9	1300	30.0	27.1	0.90	3.17	40.8	9.5	8.5
	11.5	2.59	6.0									9.0	2.07	4.8	1000	27.8	27.5	0.99	3.09	38.3	9.0	8.9
120	5.5	0.73	1.7	Operation not recommended							120	4.5	0.49	0.8	1000	28.0	25.7	0.92	3.85	41.1	7.3	9.9
	8.0	1.91	4.4									7.0	1.20	2.8	1300	27.6	26.0	0.95	3.75	40.4	7.3	10.2
	11.5	2.49	5.8									9.0	1.99	4.6	1000	28.3	26.1	0.92	3.69	40.9	7.7	10.3
				1300	27.7	26.5	0.96	3.70	40.3	7.5		10.5										
1000	28.4	26.6	0.94	3.59	40.6	7.9	10.7															
1300	28.2	26.8	0.95	3.59	40.4	7.9	10.7															

Performance capacities shown in thousands of Btu/h.

7/30/15

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



# Performance Data cont.

## 048 - 50% Part Load

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							EWT °F	Flow gpm	WPD		COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC mBtuh	Power kW	HE MBtuh	LAT °F	COP	HWC MBtuh			Airflow cfm	TC MBtuh	SC MBtuh	S/T Ratio	Power kW	HR MBtuh	EER	HWC MBtuh		
20	3.5	0.56	1.3	Operation not recommended							20	3.0	0.47	1.1	Operation not recommended							
	5.0	0.97	2.2	Operation not recommended								4.5	0.81	1.9	Operation not recommended							
	6.5	1.37	3.2	650	17.6	1.55	12.3	95.0	3.33	2.4		6.0	1.16	2.7	Operation not recommended							
30	3.5	0.55	1.3	650	20.0	1.54	14.8	98.5	3.81	2.7	30	3.0	0.45	1.1	500	27.9	15.3	0.55	0.56	29.8	49.9	-
				900	20.3	1.57	15.0	90.9	3.80	2.4					750	27.3	15.2	0.56	0.62	29.4	44.3	-
	5.0	0.94	2.2	650	21.0	1.58	15.6	100.0	3.90	3.0		4.5	0.79	1.8	500	27.8	15.3	0.55	0.54	29.7	51.6	-
				900	21.5	1.60	16.0	92.1	3.94	2.6		750			26.9	15.8	0.58	0.65	29.2	41.3	-	
	6.5	1.33	3.1	650	21.5	1.60	16.0	100.6	3.94	3.1		6.0	1.12	2.6	500	28.3	17.2	0.61	0.53	30.1	53.0	-
				900	21.8	1.61	16.3	92.4	3.96	2.6		750			27.4	15.6	0.57	0.61	29.5	44.9	-	
40	3.5	0.53	1.2	650	24.0	1.58	18.6	104.2	4.45	3.0	40	3.0	0.44	1.0	500	29.3	17.6	0.60	0.65	31.5	45.1	-
				900	24.5	1.59	19.0	95.2	4.49	2.6					750	29.2	17.9	0.61	0.73	31.7	40.3	-
	5.0	0.91	2.1	650	25.2	1.62	19.7	106.0	4.57	3.3		4.5	0.77	1.8	500	29.3	17.6	0.60	0.63	31.5	46.7	-
				900	25.7	1.63	20.2	96.5	4.64	2.8		750			29.1	18.3	0.63	0.74	31.6	39.6	-	
	6.5	1.29	3.0	650	25.7	1.64	20.1	106.6	4.59	3.4		6.0	1.09	2.5	500	29.7	17.8	0.60	0.62	31.8	47.6	-
				900	26.2	1.64	20.6	96.9	4.68	2.8		750			29.4	18.3	0.62	0.70	31.8	42.3	-	
50	3.5	0.51	1.2	650	26.7	1.66	21.1	108.1	4.71	3.3	50	3.0	0.43	1.0	500	31.0	19.9	0.64	0.75	33.6	41.6	-
				900	27.3	1.66	21.6	98.1	4.81	2.8					750	31.1	20.7	0.66	0.83	34.0	37.3	-
	5.0	0.88	2.0	650	28.1	1.70	22.3	110.0	4.84	3.6		4.5	0.74	1.7	500	31.1	20.0	0.64	0.72	33.6	43.2	-
				900	28.6	1.70	22.8	99.4	4.94	3.0		750			31.1	20.9	0.67	0.82	33.9	38.0	-	
	6.5	1.25	2.9	650	28.5	1.72	22.6	110.6	4.85	3.8		6.0	1.06	2.4	500	31.4	20.1	0.64	0.72	33.9	43.9	-
				900	29.2	1.71	23.3	100.0	4.99	3.3		750			31.5	20.9	0.66	0.78	34.1	40.3	-	
60	3.5	0.50	1.1	650	30.4	1.72	24.6	113.4	5.19	3.7	60	3.0	0.41	1.0	500	29.0	19.4	0.67	0.93	32.2	31.3	1.2
				900	31.1	1.70	25.3	102.0	5.36	3.0					750	29.7	20.6	0.70	1.02	33.1	29.2	1.2
	5.0	0.85	2.0	650	31.9	1.75	25.9	115.4	5.32	3.9		4.5	0.72	1.7	500	29.1	19.5	0.67	0.89	32.2	32.6	1.3
				900	32.7	1.74	26.7	103.6	5.50	3.3		750			29.8	20.7	0.70	0.99	33.2	30.2	1.3	
	6.5	1.21	2.8	650	32.4	1.78	26.3	116.2	5.34	4.1		6.0	1.02	2.4	500	29.4	19.6	0.67	0.89	32.4	33.2	1.4
				900	33.2	1.75	27.2	104.2	5.55	3.5		750			30.0	20.9	0.70	0.95	33.2	31.6	1.4	
70	3.5	0.48	1.1	650	34.1	1.80	27.9	118.5	5.56	4.0	70	3.0	0.40	0.9	500	27.0	19.0	0.70	1.11	30.8	24.3	1.7
				900	33.9	1.79	27.8	104.9	5.55	3.3					750	27.5	20.2	0.74	1.29	31.9	21.3	1.8
	5.0	0.83	1.9	650	35.6	1.83	29.3	120.6	5.69	4.3		4.5	0.70	1.6	500	27.1	19.1	0.70	1.07	30.8	25.3	1.9
				900	36.6	1.81	30.5	107.7	5.94	3.6		750			28.5	20.6	0.72	1.15	32.4	24.7	1.9	
	6.5	1.17	2.7	650	35.6	1.84	29.3	120.7	5.67	4.5		6.0	0.99	2.3	500	26.9	18.0	0.67	1.08	30.6	24.9	1.9
				900	37.2	1.82	31.0	108.3	5.99	3.7		750			28.5	20.8	0.73	1.12	32.3	25.4	2.0	
80	3.5	0.46	1.1	650	36.4	1.83	30.1	121.8	5.83	4.2	80	3.0	0.39	0.9	500	25.6	18.5	0.72	1.33	30.2	19.2	2.5
				900	37.4	1.84	31.2	108.5	5.96	3.5					750	26.3	19.8	0.75	1.42	31.2	18.5	2.5
	5.0	0.80	1.8	650	38.0	1.87	31.6	124.1	5.95	4.5		4.5	0.67	1.6	500	25.8	18.7	0.72	1.28	30.2	20.1	2.6
				900	39.2	1.88	32.8	110.4	6.11	3.8		750			26.6	19.8	0.75	1.35	31.2	19.6	2.7	
	6.5	1.13	2.6	650	38.6	1.91	32.1	125.0	5.93	4.8		6.0	0.96	2.2	500	26.0	18.9	0.72	1.26	30.3	20.7	2.8
				900	39.9	1.90	33.4	111.0	6.15	4.0		750			26.7	20.0	0.75	1.32	31.2	20.3	3.2	
90	3.5	0.45	1.0	650	38.7	1.88	32.3	125.2	6.04	4.5	90	3.0	0.37	0.9	500	24.2	18.1	0.75	1.55	29.5	15.6	3.4
				900	40.0	1.89	33.6	111.2	6.20	3.7					750	24.4	19.1	0.78	1.65	30.0	14.8	3.4
	5.0	0.77	1.8	650	40.4	1.92	33.9	127.6	6.17	4.8		4.5	0.65	1.5	500	24.4	18.3	0.75	1.49	29.5	16.4	3.5
				900	41.8	1.93	35.3	113.0	6.36	4.0		750			24.7	19.1	0.77	1.56	30.0	15.8	3.6	
	6.5	1.09	2.5	650	41.1	1.97	34.3	128.5	6.11	5.2		6.0	0.92	2.1	500	24.7	18.5	0.75	1.46	29.6	16.8	3.7
				900	42.6	1.95	35.9	113.8	6.40	4.3		750			24.9	19.3	0.77	1.51	30.1	16.5	3.7	
100	3.5	0.43	1.0	Operation not recommended							100	3.0	0.36	0.8	500	22.8	17.7	0.77	1.86	29.2	12.3	4.3
	5.0	0.74	1.7	Operation not recommended								4.5	0.62	1.4	500	23.0	17.9	0.78	1.79	29.1	12.9	4.4
	6.5	1.05	2.4	Operation not recommended								6.0	0.89	2.1	500	23.3	18.6	0.80	1.83	29.5	12.7	4.4
110	3.5	0.41	1.0	Operation not recommended							110	3.0	0.35	0.8	500	21.4	17.2	0.80	2.17	28.8	9.9	5.0
				750	21.7	17.9	0.83	2.19	29.1	9.9					5.0							
	5.0	0.71	1.6	Operation not recommended								4.5	0.60	1.4	500	21.7	17.4	0.81	2.08	28.8	10.4	5.4
				750	21.9	18.2	0.83	2.10	29.1	10.4		5.4										
	6.5	1.01	2.3	Operation not recommended								6.0	0.86	2.0	500	21.9	17.7	0.81	2.03	28.8	10.8	5.8
				750	22.1	18.4	0.83	2.05	29.1	10.8		5.8										
120	3.5	0.40	0.9	Operation not recommended							120	3.0	0.33	0.8	500	19.7	16.0	0.81	2.63	28.7	7.5	6.4
				750	19.4	16.0	0.83	2.53	28.1	7.7					6.5							
	5.0	0.68	1.6	Operation not recommended								4.5	0.58	1.3	500	20.0	16.2	0.81	2.52	28.5	7.9	6.6
				750	19.6	16.5	0.85	2.52	28.2	7.7		6.6										
	6.5	0.97	2.2	Operation not recommended								6.0	0.82	1.9	500	20.3	16.9	0.83	2.42	28.6	8.4	6.8
				750	19.9	16.7	0.84	2.45	28.3	8.1		6.8										

Performance capacities shown in thousands of Btuh.

7/30/15

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.



Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



# Performance Data cont.

## 048 - 100% Full Load

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F						EWT °F	Flow gpm	WPD		COOLING - EAT 80/67 °F								
		PSI	FT	Airflow cfm	HC MBtuh	Power kW	HE MBtuh	LAT °F	COP			HWC MBtuh	PSI	FT	Airflow cfm	TC MBtuh	SC MBtuh	S/T Ratio	Power kW	HR MBtuh	EER	HWC MBtuh
20	6.5	1.40	3.2	Operation not recommended						20	5.5	1.05	2.4	Operation not recommended								
	10.0	2.85	6.6								8.0	2.00	4.6									
	13.5	4.79	11.1	1500	40.6	3.67	28.1	95.1	3.24		6.05	10.5	2.94	6.8								
30	6.5	1.36	3.2	1500	44.9	3.86	31.7	97.7	3.41	6.6	30	5.5	1.02	2.4	1000	52.6	36.3	0.69	1.33	57.1	39.7	-
				1800	45.8	3.93	32.4	93.5	3.41	6.1					1400	51.5	36.3	0.70	1.48	56.6	34.8	-
	10.0	2.77	6.4	1500	45.3	3.90	32.0	98.0	3.40	6.8		8.0	1.94	4.5	1000	52.5	36.2	0.69	1.28	56.9	41.0	-
				1800	46.2	3.97	32.6	93.8	3.41	6.1		1400			50.9	37.3	0.73	1.55	56.1	32.8	-	
	13.5	4.65	10.7	1500	45.9	4.11	31.9	98.4	3.27	6.9		10.5	2.85	6.6	1000	52.7	36.5	0.69	1.29	57.1	41.0	-
1800	47.6	4.07	33.7	94.5	3.43	6.3	1400	51.7	36.9	0.71	1.45	56.6			35.7	-						
40	6.5	1.32	3.1	1500	49.7	3.94	36.3	100.7	3.70	7.0	40	5.5	0.99	2.3	1000	54.4	37.4	0.69	1.56	59.7	34.9	-
				1800	50.4	4.00	36.8	95.9	3.70	6.2					1400	54.3	38.3	0.71	1.75	60.2	31.1	-
	10.0	2.69	6.2	1500	50.2	3.95	36.7	101.0	3.72	7.3		8.0	1.88	4.3	1000	54.5	37.4	0.69	1.50	59.6	36.2	-
				1800	51.4	4.04	37.6	96.4	3.73	6.4		1400			54.0	39.0	0.72	1.76	60.0	30.6	-	
	13.5	4.51	10.4	1500	51.6	4.04	37.8	101.8	3.74	7.5		10.5	2.77	6.4	1000	54.9	37.6	0.69	1.50	60.0	36.5	-
1800	52.6	4.11	38.6	97.1	3.75	6.5	1400	54.6	38.9	0.71	1.67	60.3			32.8	-						
50	6.5	1.28	3.0	1500	58.0	4.04	44.2	105.8	4.20	7.5	50	5.5	0.96	2.2	1000	56.7	38.9	0.69	1.80	62.9	31.5	-
				1800	58.6	4.09	44.6	100.1	4.20	7.0					1400	56.9	40.4	0.71	2.01	63.8	28.3	-
	10.0	2.60	6.0	1500	58.6	4.03	44.8	106.2	4.26	8.2		8.0	1.82	4.2	1000	56.9	39.0	0.69	1.73	62.8	32.8	-
				1800	60.1	4.13	46.0	100.9	4.27	7.2		1400			56.9	40.8	0.72	1.97	63.7	28.8	-	
	13.5	4.37	10.1	1500	59.9	4.16	45.7	107.0	4.22	8.4		10.5	2.68	6.2	1000	57.4	39.2	0.68	1.72	63.3	33.3	-
1800	61.2	4.17	47.0	101.5	4.30	8.6	1400	57.5	40.8	0.71	1.88	63.9			30.6	-						
60	6.5	1.24	2.9	1500	63.2	3.99	49.6	109.0	4.64	7.6	60	5.5	0.93	2.2	1000	52.7	36.9	0.70	2.11	60.0	24.9	2.6
				1800	64.2	4.03	50.5	103.0	4.67	7.1					1400	53.9	39.2	0.73	2.32	61.8	23.3	2.8
	10.0	2.52	5.8	1500	64.7	4.01	51.0	110.0	4.73	8.4		8.0	1.76	4.1	1000	52.9	37.1	0.70	2.04	59.9	26.0	2.9
				1800	65.7	4.07	51.8	103.8	4.73	7.2		1400			54.2	39.4	0.73	2.25	61.9	24.1	2.9	
	13.5	4.23	9.8	1500	66.2	4.08	52.2	110.8	4.75	8.6		10.5	2.60	6.0	1000	53.5	37.3	0.70	2.02	60.3	26.5	2.8
1800	67.5	4.13	53.4	104.7	4.79	7.4	1400	54.5	39.6	0.73	2.17	61.9			25.2	3.0						
70	6.5	1.20	2.8	1500	67.6	4.02	53.9	111.7	4.93	8.1	70	5.5	0.90	2.1	1000	48.8	35.0	0.72	2.44	57.1	20.0	3.4
				1800	68.3	3.94	54.9	105.1	5.08	7.5					1400	47.6	34.4	0.72	2.52	56.2	18.9	3.7
	10.0	2.44	5.6	1500	71.3	4.00	57.7	114.0	5.23	8.6		8.0	1.71	3.9	1000	49.0	35.2	0.72	2.34	57.0	20.9	3.9
				1800	71.6	4.02	57.9	106.9	5.23	7.9		1400			51.5	38.0	0.74	2.52	60.1	20.4	3.9	
	13.5	4.09	9.5	1500	72.6	4.61	56.9	114.8	4.62	9.4		10.5	2.51	5.8	1000	50.4	34.9	0.69	2.30	58.3	21.9	3.9
1800	74.3	4.10	60.3	108.2	5.31	8.2	1400	51.5	38.4	0.75	2.45	59.8			21.0	4.1						
80	6.5	1.16	2.7	1500	74.9	4.01	61.3	116.3	5.48	9.0	80	5.5	0.87	2.0	1000	45.8	34.2	0.75	2.84	55.5	16.1	5.4
				1800	76.3	4.01	62.6	109.3	5.57	7.7					1400	47.0	36.6	0.78	3.03	57.3	15.5	5.4
	10.0	2.35	5.4	1500	78.3	4.08	64.4	118.3	5.63	9.5		8.0	1.65	3.8	1000	46.1	34.5	0.75	2.73	55.4	16.9	5.7
				1800	79.0	4.03	65.2	110.6	5.74	7.9		1400			47.5	36.6	0.77	2.88	57.3	16.5	5.7	
	13.5	3.95	9.1	1500	79.6	4.13	65.5	119.1	5.65	9.6		10.5	2.42	5.6	1000	46.5	34.8	0.75	2.68	55.7	17.3	5.9
1800	81.1	4.16	67.0	111.7	5.72	9.0	1400	47.7	37.0	0.77	2.80	57.2			17.0	5.9						
90	6.5	1.12	2.6	1500	81.0	4.04	67.3	120.0	5.88	9.7	90	5.5	0.84	1.9	1000	42.7	33.4	0.78	3.24	53.8	13.2	6.7
				1800	82.3	4.03	68.6	112.4	5.99	8.6					1400	43.0	35.1	0.82	3.43	54.7	12.5	6.6
	10.0	2.27	5.2	1500	85.3	4.13	71.2	122.7	6.05	9.5		8.0	1.59	3.7	1000	43.0	33.7	0.78	3.11	53.6	13.8	7.0
				1800	86.3	4.03	72.6	114.4	6.28	8.9		1400			43.5	35.1	0.81	3.24	54.5	13.4	7.0	
	13.5	3.81	8.8	1500	85.7	4.35	70.9	122.9	5.77	10.4		10.5	2.34	5.4	1000	43.5	34.1	0.78	3.06	53.9	14.2	7.3
1800	88.0	4.20	73.7	115.3	6.14	9.7	1400	43.9	35.5	0.81	3.15	54.6			13.9	7.4						
100	6.5	1.08	2.5	Operation not recommended						100	5.5	0.81	1.9	1000	40.8	32.5	0.80	3.78	53.7	10.8	8.9	
	10.0	2.19	5.1								8.0	1.53	3.5	1000	41.1	34.1	0.83	3.90	54.4	10.5	8.8	
	13.5	3.67	8.5								10.5			2.25	5.2	1000	41.1	32.9	0.80	3.63	53.5	11.3
110	6.5	1.04	2.4	Operation not recommended						110	5.5	0.78	1.8	1000	38.8	31.7	0.82	4.32	53.6	9.0	10.6	
				10.0	2.11	4.9								8.0	1.47	3.4	1000	39.2	32.1	0.82	4.14	53.3
	13.5	3.53	8.2								10.5	2.17	5.0	1000			39.6	33.5	0.85	4.18	53.9	9.5
120	6.5	1.00	2.3	Operation not recommended						120	5.5			0.75	1.7	1000	36.1	29.1	0.80	5.02	53.2	7.2
				10.0	2.02	4.7							8.0			1.42	3.3	1000	35.6	29.5	0.83	4.89
	13.5	3.39	7.8								10.5	2.08	4.8	1000	36.5			29.5	0.81	4.81	52.9	7.6
				1400	35.8	30.1	0.84	4.82	52.2		7.4			13.6								
	1400	36.6	30.1	0.82	4.68	52.6	7.8	13.8														
1400	36.4	30.4	0.83	4.68	52.4	7.8	14.0															

Performance capacities shown in thousands of Btuh.

7/30/15

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Performance Data cont.

### 060 - 50% Part Load

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F						EWT °F	Flow gpm	WPD		COOLING - EAT 80/67 °F								
		PSI	FT	Airflow cfm	HC mBtuh	Power kW	HE MBtuh	LAT °F	COP			HWC MBtuh	PSI	FT	Airflow cfm	TC MBtuh	SC MBtuh	S/T Ratio	Power kW	HR MBtuh	EER	HWC MBtuh
20	4.5	0.63	1.5	Operation not recommended						20	4.0	0.43	1.0	Operation not recommended								
	6.3	1.17	2.7								6.0	1.22	2.8									
	8.5	1.94	4.5	850	22.5	2.18	15.0	94.5	3.02		3.4	7.5	1.80	4.2								
30	4.5	0.61	1.4	850	26.0	2.15	18.7	98.3	3.55	3.9	30	4.0	0.42	1.0	700	36.8	21.4	0.58	0.74	39.3	49.7	-
				1100	26.5	2.18	19.1	92.3	3.56	3.4					950	35.6	21.4	0.60	0.83	38.5	42.7	-
	6.3	1.14	2.6	850	26.3	2.17	18.9	98.6	3.55	4.1	6.0	1.18	2.7	700	36.8	21.4	0.58	0.72	39.2	51.4	-	
				1100	26.8	2.21	19.2	92.5	3.56	3.5				950	35.6	22.0	0.62	0.87	38.6	41.1	-	
	8.5	1.89	4.4	850	26.6	2.29	18.8	99.0	3.41	4.2	7.5	1.75	4.0	700	37.5	22.6	0.60	0.70	39.9	53.2	-	
				1100	27.6	2.26	19.9	93.2	3.57	3.6				950	36.2	21.8	0.60	0.81	39.0	44.7	-	
40	4.5	0.60	1.4	850	30.9	2.22	23.3	103.7	4.08	4.3	40	4.0	0.41	0.9	700	37.3	23.1	0.62	0.88	40.3	42.4	-
				1100	31.4	2.25	23.7	96.4	4.10	3.7					950	37.0	23.7	0.64	0.99	40.4	37.5	-
	6.3	1.10	2.5	850	31.2	2.23	23.6	104.0	4.08	4.5	6.0	1.15	2.6	700	37.3	23.1	0.62	0.85	40.2	43.9	-	
				1100	32.0	2.28	24.2	96.9	4.11	3.8				950	37.0	24.1	0.65	0.99	40.4	37.2	-	
	8.5	1.83	4.2	850	32.1	2.28	24.3	105.0	4.12	4.7	7.5	1.70	3.9	700	37.8	23.6	0.63	0.84	40.7	44.9	-	
				1100	32.7	2.32	24.8	97.5	4.14	3.9				950	37.4	24.0	0.64	0.94	40.6	39.8	-	
50	4.5	0.58	1.3	850	35.2	2.34	27.2	108.3	4.41	4.7	50	4.0	0.40	0.9	700	38.1	25.0	0.66	1.02	41.6	37.2	-
				1100	35.5	2.36	27.4	99.9	4.40	3.9					950	38.2	26.0	0.68	1.14	42.1	33.4	-
	6.3	1.07	2.5	850	35.5	2.33	27.6	108.7	4.46	4.9	6.0	1.11	2.6	700	38.2	25.1	0.66	0.99	41.5	38.7	-	
				1100	36.4	2.39	28.3	100.7	4.47	4.1				950	38.2	26.3	0.69	1.12	42.0	34.0	-	
	8.5	1.77	4.1	850	36.3	2.41	28.1	109.6	4.42	5.2	7.5	1.64	3.8	700	38.5	25.2	0.65	0.98	41.9	39.3	-	
				1100	37.1	2.41	28.9	101.2	4.51	4.6				950	38.6	26.3	0.68	1.07	42.3	36.1	-	
60	4.5	0.56	1.3	850	39.3	2.33	31.3	112.8	4.94	5.1	60	4.0	0.38	0.9	700	37.2	25.7	0.69	1.31	41.7	28.4	1.5
				1100	39.9	2.35	31.9	103.6	4.98	4.2					950	38.1	27.3	0.72	1.43	43.0	26.5	1.6
	6.3	1.03	2.4	850	40.2	2.34	32.2	113.8	5.03	5.3	6.0	1.08	2.5	700	37.3	25.8	0.69	1.26	41.6	29.6	1.7	
				1100	40.8	2.37	32.7	104.3	5.04	4.5				950	38.3	27.4	0.72	1.39	43.0	27.5	1.7	
	8.5	1.72	4.0	850	41.1	2.38	33.0	114.7	5.06	5.6	7.5	1.59	3.7	700	37.7	26.0	0.69	1.25	42.0	30.2	1.8	
				1100	41.9	2.41	33.7	105.3	5.10	4.7				950	38.5	27.6	0.72	1.34	43.0	28.7	1.8	
70	4.5	0.54	1.2	850	42.7	2.33	34.7	116.5	5.36	5.4	70	4.0	0.37	0.9	700	36.3	26.3	0.73	1.60	41.8	22.7	2.1
				1100	44.8	2.40	36.6	107.7	5.47	4.5					950	38.9	28.4	0.73	1.77	45.0	22.0	2.3
	6.3	1.00	2.3	850	43.3	2.39	35.1	117.2	5.31	5.8	6.0	1.04	2.4	700	36.5	26.5	0.73	1.54	41.7	23.7	2.4	
				1100	45.2	2.33	37.3	108.1	5.68	4.8				950	38.3	28.6	0.75	1.66	44.0	23.1	2.4	
	8.5	1.66	3.8	850	44.8	2.44	36.5	118.8	5.38	6.0	7.5	1.54	3.6	700	36.0	23.1	0.64	1.58	41.4	22.8	2.5	
				1100	46.9	2.38	38.8	109.5	5.78	5.0				950	38.3	28.9	0.75	1.61	43.8	23.8	2.5	
80	4.5	0.52	1.2	850	46.8	2.36	38.8	121.0	5.81	5.8	80	4.0	0.36	0.8	700	35.5	27.0	0.76	1.83	41.7	19.3	3.1
				1100	47.7	2.36	39.6	110.1	5.91	4.8					950	36.4	28.9	0.79	1.96	43.1	18.6	3.2
	6.3	0.97	2.2	850	48.9	2.40	40.7	123.3	5.97	6.2	6.0	1.00	2.3	700	35.7	27.2	0.76	1.76	41.7	20.2	3.3	
				1100	49.2	2.39	41.0	111.4	6.03	5.1				950	36.8	28.9	0.78	1.86	43.1	19.7	3.4	
	8.5	1.60	3.7	850	49.7	2.43	41.4	124.2	5.99	6.6	7.5	1.49	3.4	700	36.0	27.4	0.76	1.74	42.0	20.8	3.5	
				1100	50.7	2.45	42.3	112.7	6.06	5.4				950	37.0	29.2	0.79	1.81	43.1	20.4	4.0	
90	4.5	0.50	1.2	850	50.4	2.41	42.1	124.9	6.12	6.2	90	4.0	0.34	0.8	700	34.6	27.7	0.80	2.07	41.7	16.7	4.4
				1100	51.2	2.38	43.1	113.1	6.31	5.0					950	34.9	29.1	0.83	2.19	42.4	15.9	4.4
	6.3	0.93	2.2	850	52.5	2.48	44.0	127.2	6.20	6.6	6.0	0.97	2.2	700	34.9	27.9	0.80	1.99	41.7	17.6	4.6	
				1100	53.1	2.42	44.8	114.7	6.43	5.4				950	35.2	29.1	0.83	2.07	42.3	17.0	4.6	
	8.5	1.55	3.6	850	53.3	2.51	44.7	128.0	6.22	7.1	7.5	1.43	3.3	700	35.2	28.2	0.80	1.95	41.9	18.1	4.8	
				1100	54.7	2.47	46.3	116.0	6.48	5.8				950	35.6	29.4	0.83	2.01	42.5	17.7	4.8	
100	4.5	0.48	1.1	Operation not recommended						100	4.0	0.33	0.8	700	30.7	25.0	0.81	2.42	38.9	12.7	5.4	
	6.3	0.90	2.1								6.0	0.93	2.2	700	31.0	26.2	0.85	2.49	39.5	12.4	5.4	
	8.5	1.49	3.4								7.5	1.38	3.2	700	31.0	25.3	0.82	2.32	38.9	13.4	5.5	
110	4.5	0.47	1.1	Operation not recommended						110	4.0	0.32	0.7	700	26.8	22.3	0.83	2.76	36.2	9.7	6.3	
				950	27.0	23.3	0.86	2.79	36.6					9.7	6.3							
	6.3	0.86	2.0							6.0	0.90	2.1	700	27.1	22.7	0.84	2.65	36.1	10.2	6.8		
				950	27.3	23.6	0.86	2.68	36.5				10.2	6.8								
	8.5	1.43	3.3							7.5	1.33	3.1	700	27.3	22.9	0.84	2.58	36.1	10.6	7.2		
				950	27.6	23.9	0.87	2.61	36.5				10.6	7.2								
120	4.5	0.45	1.0	Operation not recommended						120	4.0	0.31	0.7	700	25.1	21.9	0.87	3.31	36.4	7.6	8.2	
				950	24.4	22.2	0.91	3.24	35.5					7.5	8.2							
	6.3	0.83	1.9							6.0	0.86	2.0	700	25.4	22.3	0.88	3.16	36.2	8.0	8.4		
				950	24.9	22.7	0.91	3.17	35.7				7.8	8.4								
	8.5	1.38	3.2							7.5	1.28	3.0	700	25.9	23.8	0.92	3.03	36.2	8.5	8.7		
				950	25.3	22.9	0.91	3.08	35.8				8.2	8.7								

Performance capacities shown in thousands of Btu/h.

7/30/15

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



# Performance Data cont.

## 060 - 100% Full Load

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							EWT °F	Flow gpm	WPD		COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC mBtuh	Power kW	HE MBtuh	LAT °F	COP	HWC MBtuh			PSI	FT	Airflow cfm	TC MBtuh	SC MBtuh	S/T Ratio	Power kW	HR MBtuh	EER	HWC MBtuh
20	8.5	2.00	4.6	Operation not recommended							20	6.5	1.21	2.8	Operation not recommended							
	13.0	3.52	8.1									10.0	2.70	6.2								
	17.0	6.55	15.1	1800	51.4	5.23	33.6	96.5	2.88	8.1		13.5	4.20	9.7								
30	8.5	1.95	4.5	1800	56.8	5.07	39.5	99.2	3.28	8.4	30	6.5	1.17	2.7	1500	69.5	46.4	0.67	2.05	76.5	34.0	-
				2200	57.9	5.16	40.3	94.4	3.29	7.8					1800	68.1	46.4	0.68	2.29	76.0	29.8	-
	13.0	3.42	7.9	1800	57.3	5.12	39.8	99.5	3.28	8.6		10.0	2.62	6.1	1500	69.5	46.3	0.67	1.98	76.3	35.1	-
				2200	58.4	5.21	40.6	94.6	3.28	7.9					1800	67.3	47.7	0.71	2.40	75.5	28.1	-
	17.0	6.36	14.7	1800	58.1	5.40	39.7	99.9	3.15	8.8		13.5	4.08	9.4	1500	69.7	46.7	0.67	1.99	76.5	35.1	-
2200	60.2	5.35	42.0	95.3	3.30	8.0	1800	68.4	47.2	0.69	2.24				76.0	30.5	-					
40	8.5	1.90	4.4	1800	64.8	5.16	47.2	103.3	3.68	8.9	40	6.5	1.14	2.6	1500	68.7	46.4	0.68	2.32	76.6	29.7	-
				2200	65.7	5.24	47.8	97.7	3.68	8.2					1800	68.5	47.6	0.69	2.59	77.4	26.4	-
	13.0	3.32	7.7	1800	65.4	5.18	47.7	103.7	3.70	9.2		10.0	2.55	5.9	1500	68.8	46.4	0.68	2.24	76.4	30.7	-
				2200	66.9	5.29	48.9	98.2	3.71	8.4					1800	68.2	48.4	0.71	2.62	77.1	26.0	-
	17.0	6.17	14.3	1800	67.2	5.30	49.1	104.6	3.72	9.5		13.5	3.96	9.1	1500	69.3	46.7	0.67	2.23	76.9	31.0	-
2200	68.5	5.38	50.2	98.8	3.73	8.6	1800	69.0	48.3	0.70	2.48				77.4	27.9	-					
50	8.5	1.85	4.3	1800	72.2	5.28	54.2	107.1	4.01	9.5	50	6.5	1.10	2.5	1500	68.6	47.0	0.69	2.59	77.4	26.5	-
				2200	72.9	5.34	54.7	100.7	4.00	8.6					1800	68.8	48.8	0.71	2.90	78.7	23.7	-
	13.0	3.21	7.4	1800	73.0	5.27	55.0	107.5	4.06	9.9		10.0	2.47	5.7	1500	68.7	47.1	0.69	2.50	77.2	27.5	-
				2200	74.9	5.39	56.4	101.5	4.07	8.9					1800	68.8	49.3	0.72	2.85	78.5	24.2	-
	17.0	5.98	13.8	1800	74.6	5.44	56.0	108.4	4.02	10.3		13.5	3.83	8.9	1500	69.4	47.4	0.68	2.49	77.9	27.9	-
2200	76.2	5.45	57.6	102.1	4.10	9.3	1800	69.5	49.3	0.71	2.71				78.7	25.6	-					
60	8.5	1.80	4.2	1800	80.8	5.43	62.3	111.6	4.37	10.1	60	6.5	1.07	2.5	1500	64.4	45.6	0.71	2.96	74.4	21.8	3.1
				2200	82.1	5.47	63.5	104.6	4.40	9.0					1800	65.8	48.4	0.73	3.24	76.9	20.3	3.1
	13.0	3.11	7.2	1800	82.8	5.45	64.2	112.6	4.45	10.6		10.0	2.39	5.5	1500	64.6	45.7	0.71	2.85	74.3	22.7	2.9
				2200	84.0	5.53	65.1	105.3	4.45	9.5					1800	66.2	48.6	0.73	3.14	76.9	21.0	2.9
	17.0	5.79	13.4	1800	84.6	5.55	65.7	113.5	4.47	11.1		13.5	3.71	8.6	1500	65.2	46.0	0.71	2.82	74.9	23.1	2.7
2200	86.4	5.61	67.2	106.3	4.51	9.9	1800	66.5	48.9	0.73	3.03				76.8	22.0	2.7					
70	8.5	1.75	4.0	1800	88.4	5.68	69.0	115.5	4.56	10.6	70	6.5	1.03	2.4	1500	60.2	44.1	0.73	3.32	71.5	18.1	4.6
				2200	89.9	5.63	70.7	107.8	4.68	9.5					1800	62.7	47.2	0.75	3.74	75.5	16.8	4.6
	13.0	3.01	7.0	1800	93.2	5.65	73.9	117.9	4.83	11.2		10.0	2.31	5.3	1500	60.5	44.4	0.73	3.20	71.4	18.9	4.3
				2200	93.6	5.68	74.2	109.4	4.83	10.0					1800	63.5	47.9	0.75	3.44	75.2	18.5	4.3
	17.0	5.60	12.9	1800	95.0	5.91	74.8	118.8	4.71	11.9		13.5	3.59	8.3	1500	62.2	44.0	0.71	3.14	72.9	19.8	4.2
2200	97.1	5.80	77.3	110.9	4.91	10.6	1800	63.5	48.4	0.76	3.34				74.9	19.0	4.1					
80	8.5	1.68	3.9	1800	97.6	5.74	78.0	120.2	4.98	11.8	80	6.5	0.99	2.3	1500	57.2	43.2	0.76	3.87	70.4	14.8	6.1
				2200	99.4	5.75	79.8	111.8	5.06	9.9					1800	58.7	46.2	0.79	4.13	72.8	14.2	6.1
	13.0	2.91	6.7	1800	102.0	5.84	82.1	122.5	5.12	12.2		10.0	2.23	5.2	1500	57.5	43.5	0.76	3.72	70.2	15.5	5.8
				2200	102.9	5.78	83.2	113.3	5.21	10.6					1800	59.3	46.2	0.78	3.93	72.7	15.1	5.8
	17.0	5.41	12.5	1800	103.7	6.02	83.1	123.3	5.04	12.6		13.5	3.47	8.0	1500	58.1	43.9	0.76	3.66	70.6	15.9	5.5
2200	105.7	5.96	85.4	114.5	5.19	11.2	1800	59.6	46.7	0.78	3.82				72.6	15.6	5.5					
90	8.5	1.60	3.7	1800	106.4	5.99	85.9	124.7	5.20	11.7	90	6.5	0.96	2.2	1500	54.1	42.2	0.78	4.43	69.2	12.2	8.2
				2200	108.1	5.93	87.8	115.5	5.34	10.3					1800	54.5	44.5	0.82	4.69	70.5	11.6	8.2
	13.0	2.80	6.5	1800	112.0	6.08	91.2	127.6	5.40	12.6		10.0	2.15	5.0	1500	54.5	42.7	0.78	4.25	69.0	12.8	7.8
				2200	113.3	5.93	93.1	117.7	5.60	11.1					1800	55.0	44.5	0.81	4.43	70.2	12.4	7.8
	17.0	5.22	12.1	1800	112.5	6.40	90.6	127.9	5.15	13.4		13.5	3.34	7.7	1500	55.0	43.1	0.78	4.17	69.3	13.2	7.3
2200	115.5	6.18	94.4	118.6	5.48	11.9	1800	55.6	44.9	0.81	4.30				70.3	12.9	7.4					
100	8.5	1.55	3.6	Operation not recommended							100	6.5	0.92	2.1	1500	50.2	40.6	0.81	4.99	67.2	10.1	10.3
	13.0	2.70	6.2									10.0	2.07	4.8	1800	50.7	42.5	0.84	5.15	68.2	9.8	10.3
	17.0	5.03	11.6									13.5	3.22	7.5	1500	50.7	41.1	0.81	4.79	67.0	10.6	9.7
110	8.5	1.50	3.5	Operation not recommended							110	6.5	0.89	2.1	1500	46.4	39.0	0.84	5.55	65.3	8.4	13.0
				1800	46.8	40.6	0.87	5.61	66.0	8.4					13.1							
	13.0	2.60	6.0									10.0	2.00	4.6	1500	46.8	39.5	0.84	5.32	65.0	8.8	12.3
				1800	47.3	41.2	0.87	5.37	65.7	8.8					12.4							
	17.0	4.84	11.2									13.5	3.10	7.2	1500	47.3	40.0	0.85	5.19	65.0	9.1	11.6
1800	47.8	41.7	0.87	5.24	65.7	9.1	11.7															
120	8.5	1.40	3.2	Operation not recommended							120	6.5	0.85	2.0	1500	42.8	38.6	0.90	6.32	64.4	6.8	16.1
				1800	42.2	39.2	0.93	6.15	63.2	6.9					16.2							
	13.0	2.50	5.8									10.0	1.92	4.4	1500	43.3	39.2	0.90	6.05	64.0	7.2	15.2
				1800	42.5	39.9	0.94	6.07	63.2	7.0					15.3							
	17.0	4.65	10.7									13.5	2.98	6.9	1500	43.5	40.0	0.92	5.90	63.6	7.4	14.3
1800	43.2	40.3	0.93	5.89	63.3	7.3	14.5															

Performance capacities shown in thousands of Btuh.

7/30/15

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_


Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_

# Affinity Variable Speed Series 3 - 5 Tons 60Hz



## Wiring Schematics

### Aurora Variable Speed

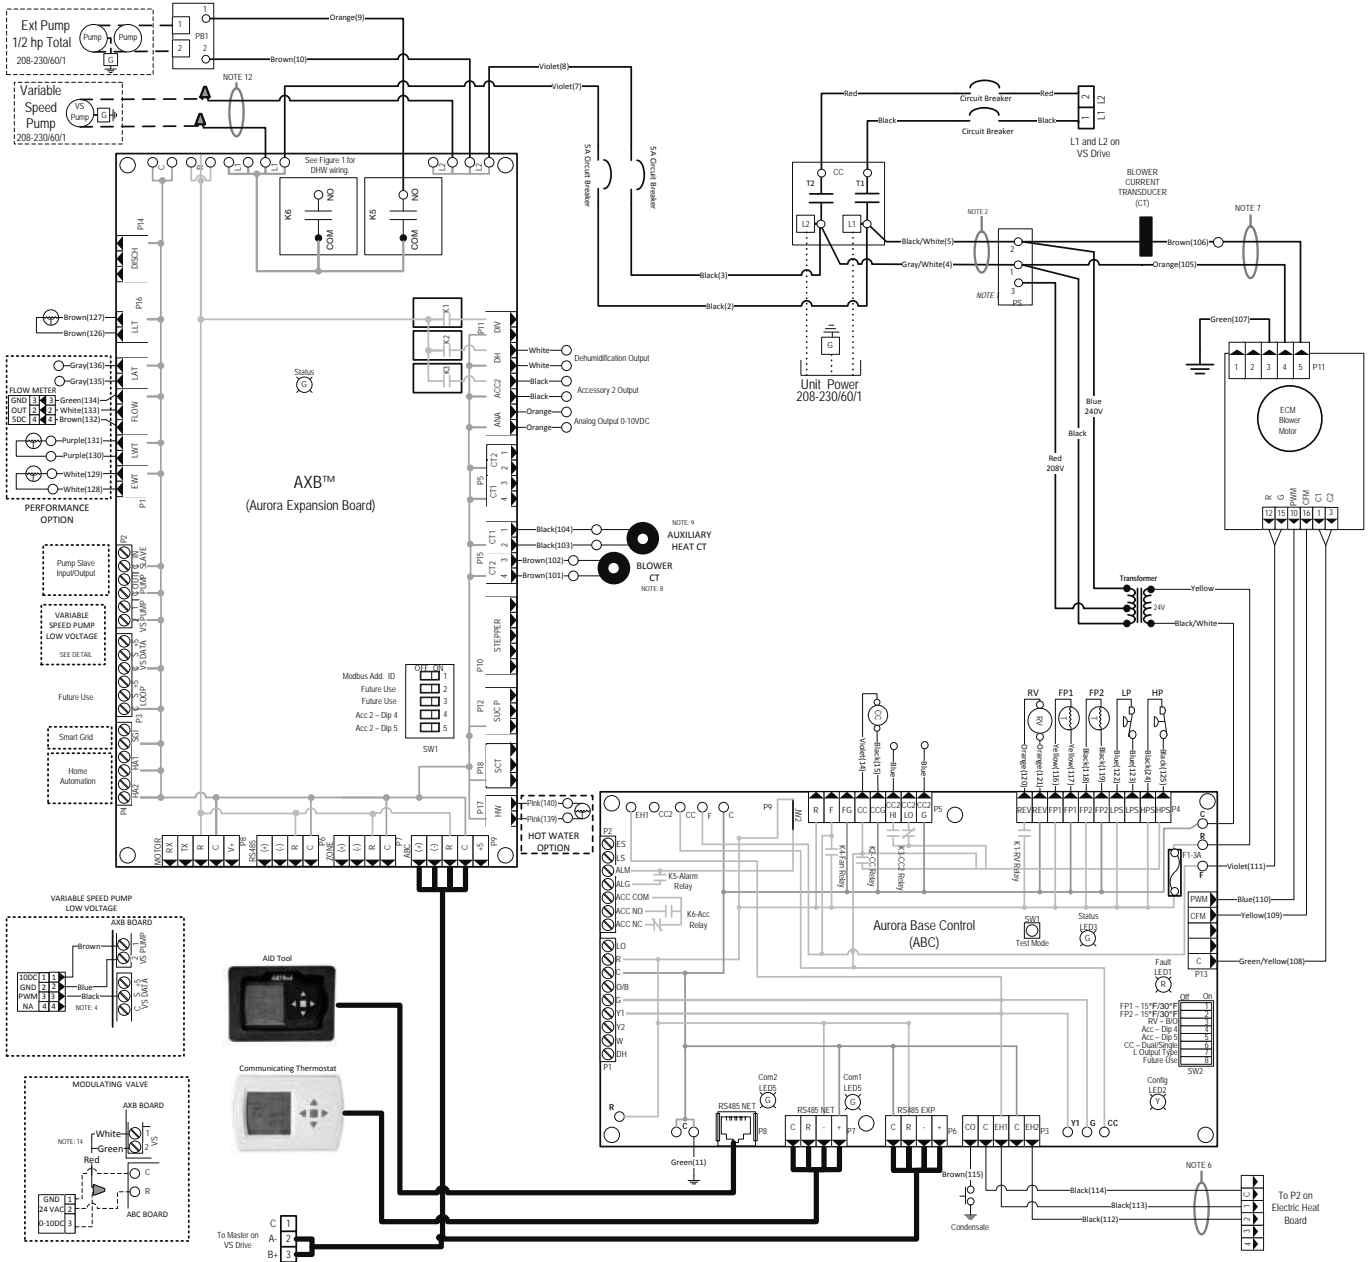

97P842-01A

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_




Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



# Wiring Schematics cont.

## Aurora Variable Speed cont.

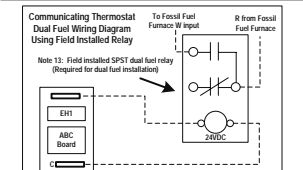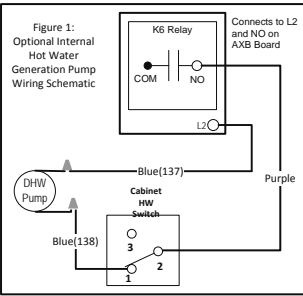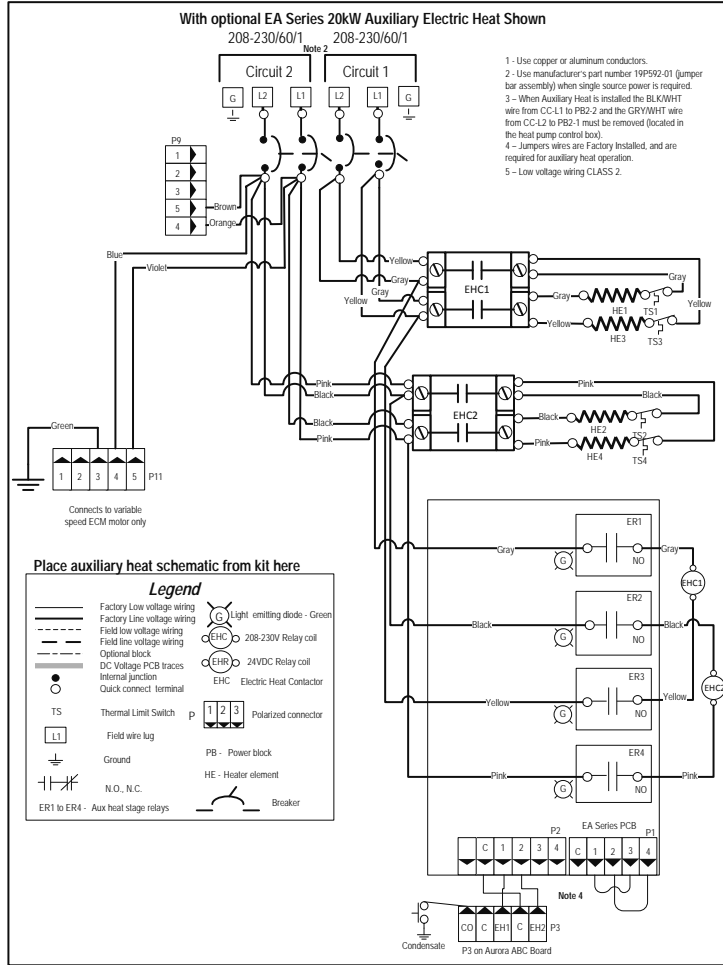

- Notes**
- 1 - Switch blue and red wires for 208V operation.
  - 2 - The blk/wh and gray/wh wires are removed when Aux Heat is installed
  - 3 - Use manufacturer's part number 19P592-01 (jumper bar assembly) when single source power is required.
  - 4 - Variable speed pump low voltage harness provided with Variable Speed Flow Center.
  - 5 - Low voltage wiring CLASS 2.
  - 6 - Wires provided for Auxiliary Heat low voltage control. Wires are secured at blower.
  - 7 - When Auxiliary Heat is field installed the harness will then be connected to the auxiliary heat unit. The auxiliary heat unit will then power the blower. Refer to EAS/EAM/EAL Auxiliary Heat kit installation instructions.
  - 8 - Brown blower power wire routed through Current Transducer two times.
  - 9 - Field Connected. Refer to Installation Manual and Auxiliary Heat Instructions for Current Transducer installation.
  - 10 - Communication cable routed through Ferrite Toroid four times.
  - 11 - Compressor power cable routed through Ferrite Toroid three times.
  - 12 - Variable speed pump power wires to connect the pump to L1 and L2 on the AXB board are provided with Variable Speed Flow Center.
  - 13 - Field installed SPST relay required for dual fuel installation.
  - 14 - Wiring harness supplied with valve.

97P842-01A







The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_  
 Engineer: \_\_\_\_\_  
 Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



# Wiring Schematics cont.

## Aurora Variable Speed Drive/EEV Wiring

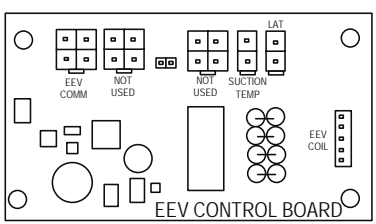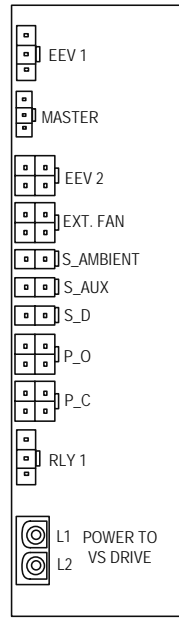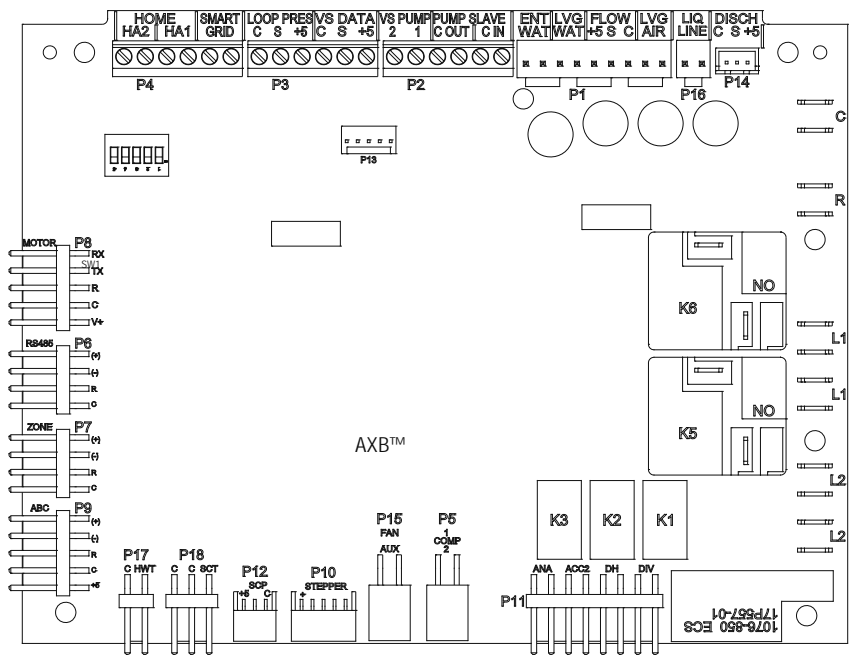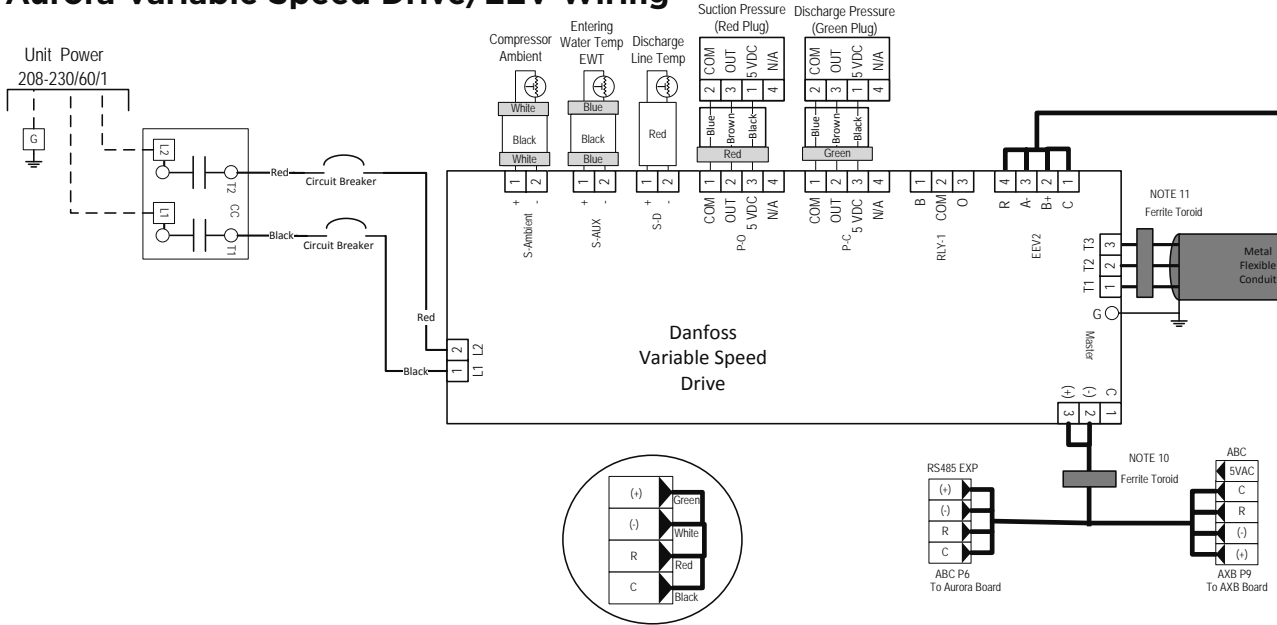


97P842-01B

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.



Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_  
 Engineer: \_\_\_\_\_  
 Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_

# Wiring Schematics cont.

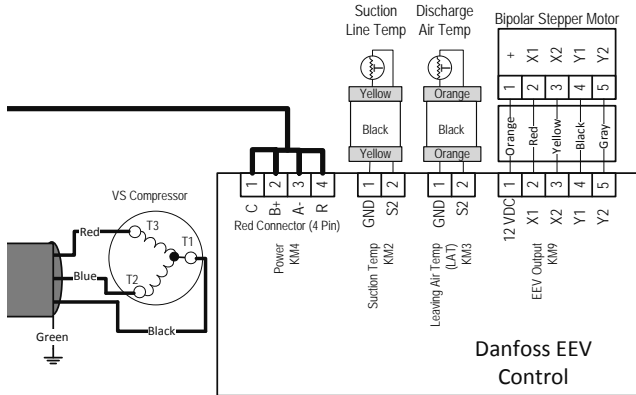


### Legend

	Factory Low voltage wiring		Thermistor
	Factory Line voltage wiring		Light emitting diode - Green
	Field low voltage wiring		Relay coil
	Field line voltage wiring		Capacitor w/ bleed resistor
	Optional block		Switch - Condensate overflow
	DC Voltage PCB traces Junction		Switch - High pressure
	Quick connect terminal		Switch - Low pressure
	Wire nut		Polarized connector
	Field wire lug		Current Transducer (CT)
	Ground		
	Relay Contacts - N.O., N.C.		
	Fuse		
	Color identification tape on wire.		

CC - Compressor Contactor	PB1, PB2 - Power blocks
CO - Condensate overflow sensor	PS - Power strip
K5 - DHW pump relay	RV - Reversing Valve coil
K6 - Loop pump relay	SW1 - DIP package 5 position AXB
CR3 - PSC Fan Speed Relay	SW1 - TEST MODE ABC Board
CR4 - PSC Fan Power Relay	SW2 - DIP package 8 position ABC Board
CS - Compressor Solenoid	
F1 and F2 - Fuses	TS - Thermal limit switch
HE - Heater element	HWL - Hot water limit sensor
HP - High pressure switch	SC - Start Contactor
ER1 to ER4 - Aux heat stage relays	SR - Start Relay
LP - Low pressure switch	WCL - Water Coil Limit Sensor

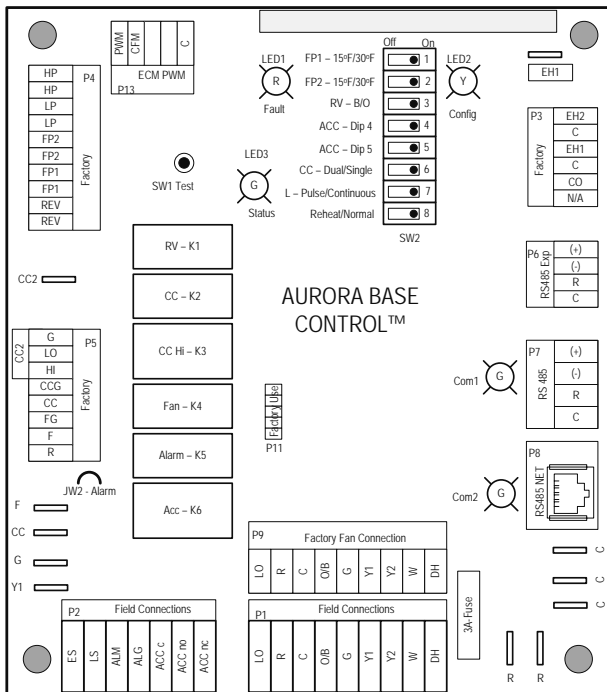

Aurora LED Flash Codes			
Slow Flash	1 second on and 1 second off		
Fast Flash	100 milliseconds on and 100 milliseconds off		
Flash Code	100 milliseconds on and 100 milliseconds off with a 2 second pause before repeating		
Fault LED (LED 1, Red)		Random Start Delay (Alternating Colors)	
Normal Mode	OFF	Status LED (LED1, Green)	Fast Flash
Input Fault Lockout	Flash Code 1	Configuration LED (LED 2, Yellow)	Fast Flash
High Pressure Lockout	Flash Code 2	Fault LED (LED 3, Red)	Fast Flash
Low Pressure Lockout	Flash Code 3	Configuration LED (LED 2, Yellow)	OFF
Freeze Detection - FP2	Flash Code 4	No Software Override	OFF
Freeze Detection - FP1	Flash Code 5	DIP Switch Override	Slow Flash
Reserved	Flash Code 6	Status LED (LED 3, Green)	ON
Condensate Overflow Lockout	Flash Code 7	Normal Mode	ON
Over/Under Voltage Shutdown	Flash Code 8	Control is Non - Functional	OFF
Future Use	Flash Code 9	Test Mode	Slow Flash
Compressor Monitoring	Flash Code 10	Lockout Active	Fast Flash
Fault - FP1 and FP2 Sensor Error	Flash Code 11	Dehumidification Mode	Flash Code 2
Future Use	Flash Code 12	Future Use	Flash Code 3
Non-Critical AXB Sensor Error	Flash Code 13	Future Use	Flash Code 4
Critical AXB Sensor Error	Flash Code 14	Load Shed	Flash Code 5
Alarm - Hot Water	Flash Code 15	ESD	Flash Code 6
Fault Variable Speed Pump	Flash Code 16	Future Use	Flash Code 7
Future Use	Flash Code 17	Fault LED (LED 1, Red) Cont.	
Non-Critical Communication Error	Flash Code 18	Safe Mode - Ambient Temperature Sensor	Flash Code 49
Fault - Critical Communication Error	Flash Code 19	Fault - Discharge Temperature Sensor	Flash Code 51
Alarm - Low Loop Pressure	Flash Code 21	Fault - Suction Pressure Sensor	Flash Code 52
Fault - Communication ECM Fan Motor Error	Flash Code 22	Fault - Condensing Pressure Sensor	Flash Code 53
Alarm - Home Automation 1	Flash Code 23	Fault - Low Supply Voltage	Flash Code 54
Alarm - Home Automation 2	Flash Code 24	Fault - Compressor Out of Envelope	Flash Code 55
Fault - EEV Error	Flash Code 25	Fault - Over Current	Flash Code 56
Derate - Drive Temperature	Flash Code 41	Fault - Over/Under Voltage	Flash Code 57
Derate - High Discharge Temperature	Flash Code 42	Fault - High Drive Temperature	Flash Code 58
Derate - Low Suction Temperature	Flash Code 43	Fault - Drive Internal Error MOC/AOC	Flash Code 59
Derate - Low Condensing Pressure	Flash Code 44	Fault - Multiple Safe Modes	Flash Code 61
Derate - High Condensing Pressure	Flash Code 45	Fault - Loss of Charge	Flash Code 71
Derate - Outer Power Limit	Flash Code 46	Safe Mode - Suction Temperature Sensor	Flash Code 72
Safe Mode - EEV (Indoor) Communication	Flash Code 47	Safe Mode - LAT Temperature Sensor	Flash Code 73
Safe Mode - EEV (Outdoor) Communication	Flash Code 48	Safe Mode - Max Operating Pressure	Flash Code 74

AXB Accessory 2 DIP Settings		
SW1-4	SW1-5	DESCRIPTION
ON	ON	Cycles with Blower
OFF	ON	Cycles with CC first stage compressor or compressor spd 1-12
ON	OFF	Cycles with CC2 second stage of compressor or comp spd 7-12
OFF	OFF	Cycles with DH from ABC board

ABC SW2 Accessory Relay		
DESCRIPTION	SW2-4	SW2-5
Cycle with Blower	ON	ON
Cycle with Compressor	OFF	OFF
Water Valve Slow Opening	ON	OFF
Cycle with Comm. T-stat Hum Cmd	OFF	ON

97P842-01B

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Engineering Guide Specifications

### General

Furnish and install York Affinity Variable Speed Series Water Source Heat Pumps, as indicated on the plans. Equipment shall be completely assembled, piped and internally wired. Capacities and characteristics as listed in the schedule and the specifications that follow. The reverse cycle heating/ cooling units shall be either suspended type with horizontal air inlet and discharge or floor mounted type with horizontal air inlet and vertical upflow, downflow, or rear air discharge. Units shall be AHRI/ISO 13256-1 certified and listed by a nationally recognized safety-testing laboratory or agency, such as ETL Testing Laboratory. Each unit shall be computer run-tested at the factory with conditioned water and operation verified to catalog data. Each unit shall be mounted on a pallet and shipped in a corrugated box or stretch-wrapped. The units shall be designed to operate with entering liquid temperature between 20°F and 120°F [-6.7°C and 48.9°C].

### Casing and Cabinet

The cabinet shall be fabricated from heavy-gauge galvanized steel and finished with corrosion-resistant powder coating. This corrosion protection system shall meet the stringent 1000 hour salt spray test per ASTM B117. The interior shall be insulated with 1/2-inch thick, multi-density, cleanable aluminum foil coated glass fiber with edges sealed or tucked under flanges to prevent the introduction of glass fibers into the discharge air. Standard cabinet panel insulation must meet NFPA 90A requirements, air erosion and mold growth limits of UL- 181, stringent fungal resistance test per ASTM-C1071 and ASTM G21, and shall meet zero level bacteria growth per ASTM G22. Unit insulation must meet these stringent requirements or unit(s) will not be accepted.

One (horizontal) to two (vertical) blower and three compressor compartment access panels shall be 'lift-out' removable with supply and return ductwork in place. The front access panel shall be lift-out to provide easy access to the electrical/compressor section. The control box shall be hinged and removable to allow easy access to the compressor. The internal component layout shall provide for service access from the front side for restricted installations.

A duct collar shall be provided on the supply air opening. Standard size 2 in. [5.1 cm] MERV 11 pleated filter shall be provided with each unit. Vertical and horizontal units shall have a return air filter rack/duct collar which is field convertible from 2 in. [5.1 cm] to 1 in. [2.5 cm]. The upflow vertical units shall have a removable insulated divider panel between the air handling section and the compressor section to minimize the transmission of compressor noise and to permit operational service testing without air bypass. Vertical units shall be supplied with left or right horizontal air inlet and top, bottom, or rear vertical air discharge. Horizontal units shall be supplied with left or right air inlet and side or end air discharge.

The compressor shall be double isolation mounted using selected durometer grommets to provide vibration free compressor mounting.

The drain pan shall be of plastic construction to inhibit corrosion and bacterial growth. Drain outlet shall be located on pan as to allow complete and unobstructed drainage of condensate. The unit as standard will be supplied with solid-state electronic condensate overflow protection. Mechanical float switches WILL NOT be accepted. Vertical units shall be furnished with a PVC slip condensate drain connection and an internal factory installed condensate trap.

### Refrigerant Circuit

All units shall contain a sealed refrigerant circuit including a hermetic motor-compressor, discharge line muffler, bidirectional electronic expansion valve, finned tube air-to-refrigerant heat exchanger, reversing valve, coaxial tube water-to-refrigerant heat exchanger, optional hot water generator coil, and service ports. Compressors shall be high-efficiency variable speed scroll type designed for heat pump duty and mounted on double vibration isolators.

Compressor motors shall be permanent magnet type. The double electro-coated air coil shall be sized for low-face velocity and constructed of patented 11 element lanced aluminum fins bonded to rifled copper tubes in a staggered pattern not less than three rows deep for enhanced performance. All models shall include discharge mufflers to help quiet compressor discharge gas pulsations.

Refrigerant to air heat exchangers shall utilize rifled copper tube construction rated to withstand 600 psig (4135 kPa) refrigerant working pressure. Refrigerant to water heat exchangers shall be of copper (cupronickel optional) inner water tube and steel refrigerant outer tube design, rated to withstand 600 psig (4135 kPa) working refrigerant pressure and 450 psig (3101 kPa) working water pressure. An electronic expansion valve shall provide proper superheat over the entire liquid temperature range with minimal "hunting." The valve shall operate bidirectionally without the use of check valves.

All units shall have the source coaxial tube refrigerant-to water heat exchanger and the optional hot water generator coil coated with ThermaShield insulation. Refrigerant suction lines shall be insulated to prevent condensation at low liquid temperatures.

### Blower Motor and Assembly

The blower shall be a direct drive centrifugal type with a dynamically balanced wheel. The housing and wheel shall be designed for quiet low outlet velocity operation. The blower housing shall be removable from the unit without disconnecting the supply air ductwork for servicing of the blower motor. The blower motor shall be a variable-speed ECM type. The ECM blower motor shall be soft starting, shall maintain constant cfm over its operating static range, and shall provide 12 cfm settings. The blower motor shall be isolated from the housing by rubber grommets. The motor shall be permanently lubricated, have thermostatic overload protection and be long-life ball bearing type.



Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Engineering Guide Specifications cont.

### Electrical

A control box shall be located within the unit compressor compartment and shall contain a 75VA transformer, 24 Volt activated, 2 pole compressor contactor, circuit breakers for protecting loop pumps and compressor drive, removable terminal block for thermostat wiring, variable speed compressor drive and solid-state controller for complete unit operation. Electromechanical operation WILL NOT be accepted. Units shall be name-plated for use with time delay fuses or HACR circuit breakers. Unit controls shall be communicating type and provide heating or cooling as required by the remote thermostat/sensor. An Aurora Advanced VS Control, a microprocessor based controller, interfaces with a digital communicating thermostat to monitor and control unit operation shall be provided. The control shall provide operational sequencing, blower speed control, blower failure, high and low pressure switch monitoring, freeze detection, hot water limit thermistor sensing, condensate overflow sensing, auxiliary heat staging, lockout mode control, hot water and loop pump control, LED status and fault indicators, fault memory, field selectable options, compressor envelope management, energy consumption measurement, and accessory output. The fault signals shall be plain English text and displayed on the thermostat.

The Aurora Advanced VS Control shall also feature an On Peak input signal for utility controlled demand programs, intelligent hot water generation with user adjustable temperature limit, loop pump slaving for multiple units driving a common flow center and up to two optional home automation inputs to drive dedicated alarms for sump pump, security system, and smoke/CO<sub>2</sub> or dirty air filter sensors. As standard, the energy and refrigerant monitoring kits will provide real time data including total power consumption, refrigerant superheat and subcooling. Optional performance monitoring kit to provide real time data including, entering and leaving water temperature, flow rate and heat of extraction/rejection capacity data. The capability for communicating to advanced zoning packages with up to six zones shall also be provided with complete fault and information display on the zoning MasterStat.

A detachable terminal block with screw terminals will be provided for field control wiring. All units shall have knockouts for entrance of low and line voltage wiring. The blower motor and control box shall be harness plug wired for easy removal.

An optional Aurora Interface Diagnostic (AID) Tool shall communicate with the Aurora control allowing quick and easy access to setup, monitoring, and troubleshooting of any Aurora control. The device shall include the features of ECM airflow setup, VS pump and modulating water valve setup, fault description and history, manual operation capability, sensor readings, timings, and other diagnostic tools.

### Piping

Supply and return water connections shall be 1 in. [25.4 mm] FPT brass swivel fittings, which provide a union and eliminate the need for pipe wrenches and sealants when making field connections. The optional hot water generator shall have sweat type connections. All source water piping shall be insulated to prevent condensation at low liquid temperatures. On the vertical units, the condensate connection shall be a 3/4 in. [19.1 mm] PVC socket with internally-trapped hose that can be routed to front or side locations.

### Hanger Kit

#### (field-installed horizontal units only)

The hanger kit shall consist of galvanized steel brackets, bolts, lock washers, and isolators and shall be designed to fasten to the unit bottom panel for suspension from 3/8- inch threaded rods. All unit size shall include six brackets hanging brackets.

### Options and Accessories

#### Cupronickel Heat Exchanger

An optional cupronickel water-to-refrigerant heat exchanger shall be provided.

#### Hot Water Generator

An optional ThermaShield coated heat reclaiming hot water generator coil of vented double-wall copper construction suitable for potable water shall be provided. The coil and hot water circulating pump shall be factory mounted inside the unit with integral electronic high limit temperature monitoring and external on/off switch. Hot water set point is selectable through the AID Tool.

#### Thermostat (field-installed)

A communicating auto-changeover electronic digital thermostat shall be provided. The thermostat shall offer variable speed heating and cooling staging with precise temperature control. An OFF-HEAT-AUTO-COOL-EMERG system switch, OFF-AUTO-INTERMITTENT blower switch, and indicating display shall be provided. The thermostat shall display in °F or °C. The thermostat shall provide real time energy consumption data of the unit.

#### Color Touchscreen Thermostat (field-installed)

A color touchscreen communicating auto-changeover electronic digital thermostat shall be provided. The thermostat shall offer variable speed heating and cooling staging with precise temperature control. An OFF-HEAT-AUTO-COOL-EMERG system switch, OFF-AUTO-INTERMITTENT blower switch, and indicating display shall be provided. The thermostat shall display in °F or °C. The thermostat shall provide real time and historical energy consumption data of the unit.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## **Engineering Guide Specifications cont.**

---

### **Electronic Air Cleaner (field-installed)**

A 1 in. [25 mm] electronic air cleaner, cleanable 97% efficiency at 0.3 microns and larger, shall be provided in lieu of the standard throwaway filter. The initial pressure drop across the filter shall not exceed 0.2 in. w.g. at 300 fpm face velocity.

### **AlpinePure MERV 13 Filter (field-installed)**

A 2 in. [50 mm] thick MERV 13 filter shall be provided in lieu of the standard filter and fits the factory filter rack. The filter maintains MERV 13 rating in full ASHRAE 52.2 independent testing as required for LEED® certification. Helps fulfill a full credit under the LEED rating system.

### **AlpinePure Drain Pan Treatment (field-installed)**

Provides dependable, sustained time-release protection from slime build-up and foul smelling odors in the drain pan. Also adds a light, pleasant scent to the air.

### **Earth Loop Flow Center (field-installed)**

A self-contained module shall provide all liquid flow, fill and connection requirements for ground source closed loop systems up to 20 gpm. The pumps shall be wired to a power block located in the nearest unit. The heat pump units shall contain low voltage pump slaving control so that two units may share one flow center.

### **Auxiliary Heater (field-installed)**

An electric resistance heater shall provide supplemental and/or emergency heating capability. Vertical units shall have the control panel and resistance heater coil assembly mounted internally. For horizontal units, the control panel shall be mounted internally while the resistance heater coil assembly shall be mounted externally. A low voltage plug shall be provided in each unit for quick auxiliary heat connection. The heater shall operate in sequenced stages as controlled by the unit's microprocessor. The heater shall feed line voltage power to the unit blower and transformer to provide emergency heat capability in the event of an open compressor circuit breaker.

Contractor: \_\_\_\_\_ P.O.: \_\_\_\_\_

Engineer: \_\_\_\_\_

Project Name: \_\_\_\_\_ Unit Tag: \_\_\_\_\_



## Revision Guide

Pages:	Description:	Date:	By:
All	Misc. Updates	04 Jan 2017	MA
Misc.	Misc. Updates, Updated Performance Data	12 Aug 2016	MA
All	Various Updates for Electric Heating Change	22 April 2015	MA
All	First Published.	01 Jul 2013	DS

The manufacturer works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely the manufacturer's opinion or commendation of its products. York and Affinity are registered trademarks of Johnson Controls, Inc., and are used with permission.

